

HDL[®] KNX/EIB FCU Actuator



- Home Automation • Hotel Solution
 - Intelligent Lighting • LED Lighting system
- Professional Stage Lighting • Show Control

HDL KNX / EIB-BUS

(Intelligent Installation Systems)

Product Manual

Contents

1-General.....	4
1.1-Product Function	5
2- Hardware	6
2.1 Technical data	6
2.2 Product and functional description TS/C 1.0.....	8
2.3 Dimension drawings	9
2.4 Wiring diagram	9
2.5 Maintenance and Cautions	11
3- Software.....	12
3.1 Database functions Overview	12
3.2 Function parameter “General”	13
3.3 Function parameter “Heating and Cooling”	15
3.3.1 Actual temperature.....	19
3.3.2 Setpoint.....	22
3.3.3 Fan	26
3.3.4 Valve.....	32
3.3.4.1 Heating/Cooling valve (relay)	32
3.3.4.2 Heating/Cooling valve (0-10v)	39
3.3.5 Function statue	42
3.4 Function parameter “Floor Heating”.....	46
3.4.1 Channel A (Floor heating)	47
3.4.1.1 ->Operation mode	50
3.4.1.2 ->Valve	53
3.5 Function parameter “Switch actuator”	58

4-Communication objects description	63
4.1 Objects “General”	63
4.2 Fan/Fan coil controller	63
4.2.1 Objects “Actual temperature”	63
4.2.2 Objects “Setpoint”	64
4.2.3 Objects “HVAC control mode”	64
4.2.4 Objects “HVAC mode”	65
4.2.5 Objects “Fan”	66
4.2.6 Objects “Fan status”	68
4.2.7 Objects “Fan limitation”	69
4.2.8 Objects “Valve Heating”	70
4.2.9 Objects “Valve Cooling”	70
4.3 Floor heating	71
4.3.1 Objects “Slave clock”	71
4.3.2 Objects “Pipe pressure protection”	72
4.3.3 Objects “Floor heating N”	72
4.4 Switch actuator	76
4.4.1 Objects “Output N”	76
5- Application	78
5.1 Program functions diagram	78
5.2 Room thermostat with the Fan Coil Controller	79
5.3 Room thermostat with the floor heating	79

1-General

HDL KNX / EIB series the Fan Coil Unit Controller is developed by HDL. Using KNX/EIB BUS communicate with other KNX devices. Database need to be downloaded to the Fan Coil Unit Controller by using ETS2 V1.3/ETS 3.0. The document describe how to use the products. Our products use standard according to EMC, electrical safety, environmental conditions.

The Fan Coil Unit Controller is used to control fan coil units (heating and cooling terminal units), floor heating or switch actuators. They are installed in the room and supplied via a central heating and cooling system. The room temperature can be very quickly adapted to individual requirements using this system.


The applications described in the following enable the control of

- **Fans**
- **Blowers**
- **Fan coil units**
- **Valves for heating or cooling**
- **Electrical loads**

The outputs which are not required for the fans, blowers and fan coil functions can be used as switch actuators for switching electrical loads or as heating actuators for controlling valves.

The rights and the copyright to this manual are exclusively the property of HDL.

1.1-Product Function

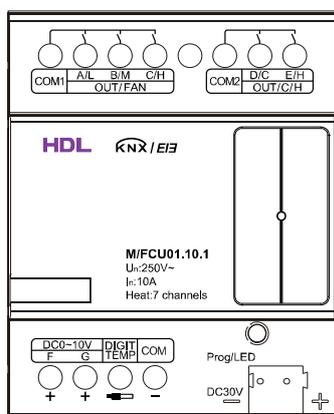

The Fan Coil Unit Controller is used to control fan coil units, floor heating or switch actuators. Depending on the design of the device, fan coil units are used in 2-pipe systems (heating only, cooling only, or heating and cooling via a common piping system) or alternatively in 4-pipe systems (heating and cooling via separate pipes). It controls up to 3 fan speeds (Relay or 0-10V outputs) as well as heating or cooling valves (Proportional or electrothermal valve) respectively. The mode of control is based on two-step control or a time-discrete PI controller with setpoint / actual value comparison. The valves and the fan can be regulated directly by devices via the closed loop of this controller. When the Fan Coil Unit Controller is used in floor heating, it is the maximum control seven channel output respectively. All of the floor heating channel control is used a time-discrete PI controller with setpoint / actual value comparison.

The following functions can be set in different functions:

- 1-Five channel 10A relay outputs
- 2-Two channel 0-10V DC outputs
- 3-Fan speed: High, Medium, Low
- 4-HVAC working mode: Heating, Cooling
- 5-HVAC operation mode: Standby mode, Comfort mode, Night mode, Frost protection
- 6-Fan speed and Valve status report
- 7-Seven local temperature sampling
- 8-BUS temperature sampling
- 9-Local temperature report
- 10-Seven channel floor heating outputs
- 11-Five control mode each floor heating channel
- 12-Seven channel output independently
- 13-Channel statistics total ON time
- 14-Channel state response
- 15-Channel state after bus voltage failure and recovery
- 16-Staircase light
- 17-Delay
- 18- PWM control output

2- Hardware

The technical properties of HDL KNX/EIB
Fan coil controls as following sections.

2.1 Technical data

Power supply

* Operating voltage(supply by the bus)	21...30 V DC,
* Current consumption EIB / KNX(operate)	< 20 mA
* Current consumption EIB / KNX(standby)	< 5 mA
* Power consumption EIB / KNX(operate)	< 600 mW
* Power consumption EIB / KNX(standby)	< 150 mW

Output nominal values

* Number of contacts	5 relay and 2 channel 0-10v
* In rated current	Relay 10 A and 0-10v 5mA
* Power loss per device at max. load	3.3 W
* Unrated voltage	250/440V AC (50/60 Hz)

Output switching life expectancy

* Mechanical Life	> 1000000
* Electrical Life (240 V/cos ϕ = 0.8)	> 100000

Connections

* EIB / KNX	Bus Connection Terminal 0.8 mm Ø, single core
* Load circuits	Screw terminal with Slotted head 0.2...4 mm ² multi- core 0.4...6 mm ² single-core
* Cable shoe	12 mm
* Tightening torque	Max. 0.8 Nm

Temperature input

* Local temperature sensor	TS/C 1.0 (max. 7 sensor) Cable length max. 50 m
* Via EIB/KNX	One or two object

Operating and display

- * Red LED and EIB / KNX program button for assignment of the physical address.
- * Green LED flashing on the EIB / KNX program button is read back the local temperature.
- * Green LED flashing on the top shell show that the device is working.

Note: Press the EIB / KNX program button 3 seconds to refresh the local temperature sensor (TS/C 1.0).

Temperature range

* Operation	– 5 °C ~ + 45 °C
* Storage	– 25 °C ~ + 55 °C
* Transport	– 25 °C ~ + 70 °C

Environment conditions

* humidity	max. 95 % Non-condensing
------------	--------------------------

Appearance design

* Modular	DIN-Rail Modular installation
* Dimensions (H x W x D)	90 mm x 72 mm x 64 mm

Weight (unit kg)

0.26

Installation

Use 35 mm mounting rail

Mounting position

Electric switch box

Material and Colour

Plastic, Black

Standard and Safety

* LVD Standard	Certificated EN60669-2-1 , EN60669-1
* EMC Standard	EN50090-2-2

CE mark

* In accordance with the EMC guideline and low voltage guideline

Pollutant

Comply with RoHS

Application table

Type	M/FCU01.10.1
Max. number of communication objects	230
Max. number of group addresses	254
Max. number of associations	254

Note: The programming requires the EIB Software Tools ETS2 V1.3 or ETS3.0. If use ETS2 V1.3, then import "*.vd2". If use ETS3.0, then Import "*.vd3"

2.2 Product and functional description TS/C 1.0



The temperature sensor measures the ambient temperature. It is connected to the Fan Coil Unit Controller via screw terminals.

The temperature sensor can only be used in combination with the Fan Coil Unit Controller M/FCU01.10.1

Technical data for TS/C 1.0

Cable

- * Cable type 3-core cable
- * Cable length 1 m
- * Cable colour black

Connections

- * Yellow cable Screw terminal "DIGIT TEMP"
- * Red cable Screw terminal "COM"
- * Black cable Screw terminal "COM"

Ambient temperature range

- * Operation - 25 °C ~ + 60 °C
- * Storage - 25 °C ~ + 60 °C
- * Transport - 25 °C ~ + 70 °C

Weight


0.05kg

Sensor serial number


The local temperature sensor serial number (e.g. 188) is used for the floor heating, setting it to the parameters *Temperature sensor serial number (1..255)* in the parameter window "Floor heating – Channel A (B,C,D,E,F,G)". One local temperature sensor correspond to one floor heating room teperature, so it can't connect the same serial number sensor on a M/FCU01.10.1.




Wiring diagram for TS/C 1.0

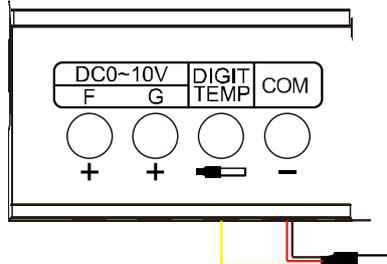

2.3 Dimension drawings

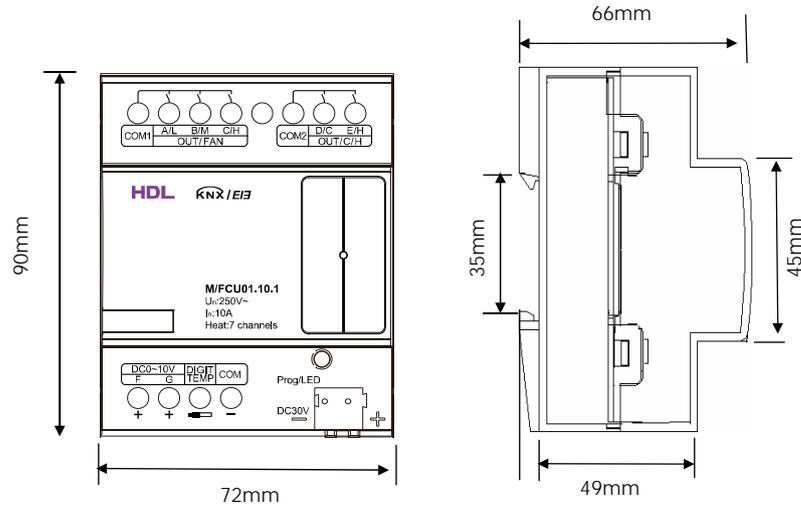

2.4 Wiring diagram

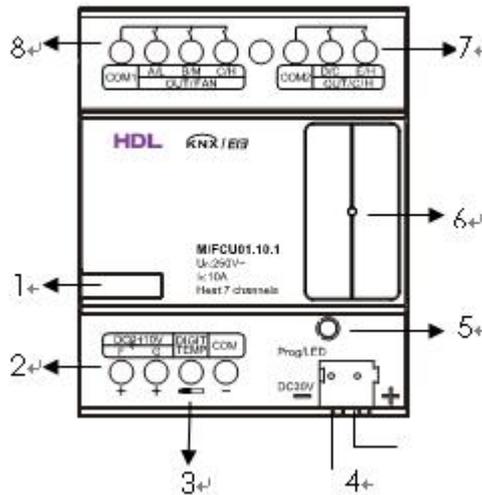


- 1- Label area
- 2- Channel F,G , output DC0-10 voltage
- 3- Local temperature ,can connect 7 temperature sensor
- 4- KNX/EIB Bus Connector
- 5- Programming button&Red programming LED&Green Local temperature LED
- 6- Green working LED
- 7- Channel D,E (Relay output)
- 8- Channel A,B,C (Relay output)


Examples for applicaton

Different configuration corresponding different wiring diagram.

1、 Fan coil units:

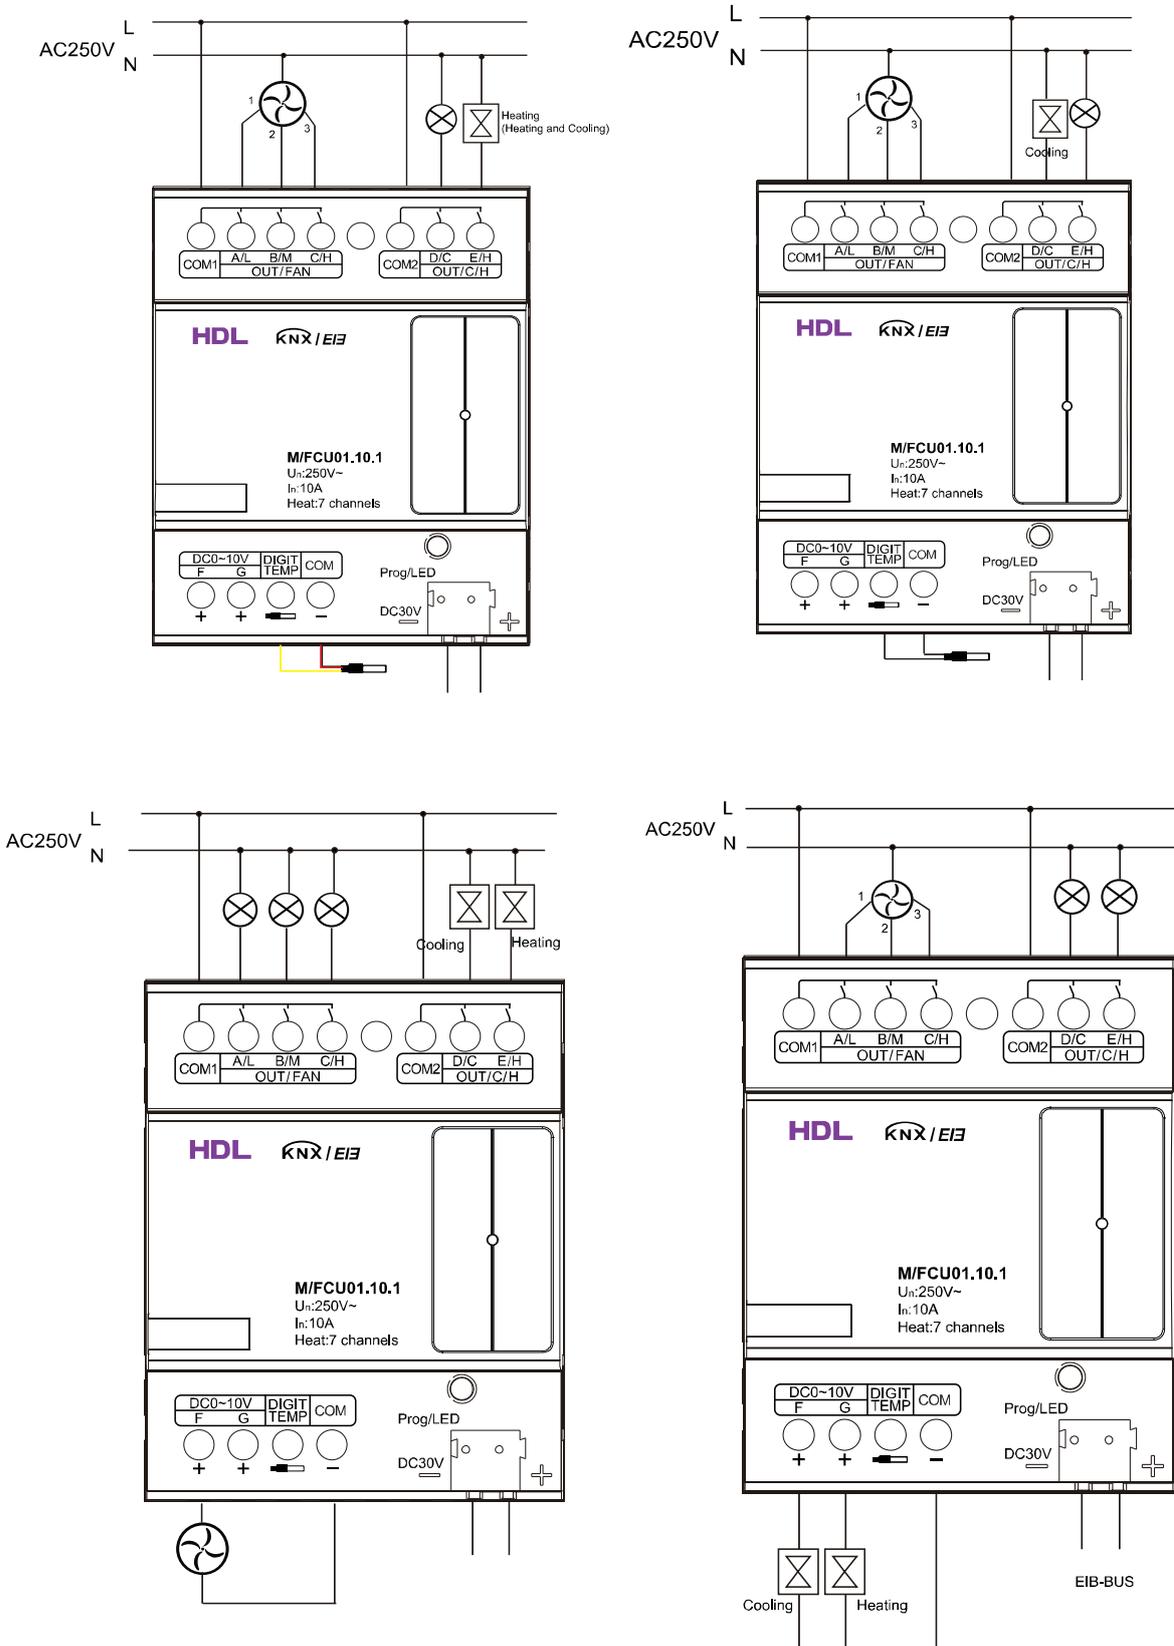

2、 Floor heating and switch actuators:

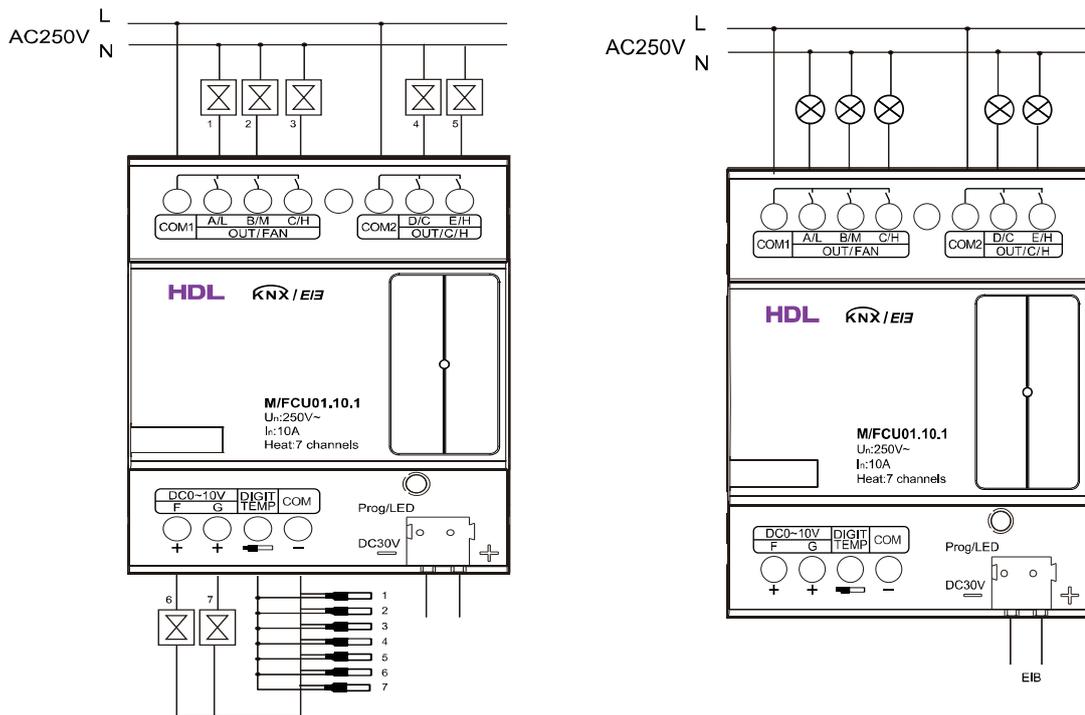

- Note:**
- Dimensions of the space to be provided for each device.
 - Dimensions and position of the means for supporting and fixing the DMX Recorder within this space
 - Minimum clearance between the various parts of the DMX Recorder and the surrounding parts where fitted
 - Minimum dimensions of ventilating opening, if needed, and their correct arrangement.

2.5 Maintenance and Cautions

- *Please read this user manual carefully before any operation.
- *Don't close to the interfering devices.
- *The site should be ventilated with good cooling environment.
- *Pay attention to damp proof, quakeproof and dustproof.
- *Avoid rain, other liquids or caustic gas.
- *Please contact professional maintenance staff or HDL service center for repair or fix.
- *Remove the dust regularly and do not wipe the unit with the volatile liquids like alcohol, gasoline, etc.
- *If damaged by damp or liquid, turn off it immediately.
- *Regularly check the circuitry and other related circuit or cables and replace the disqualified circuitry on time.
- *For security, each circuit to connect an MCB or fuse
- *Installation location should be well-ventilated, pay attention to moisture, shock, dust proof.

3- Software

HDL KNX/EIB Fan Coil Unit Controller database use ETS3.0 to do the design. The device types is M/FCU01.10.1, and the database name is “FCU 7CH Heating Actuator”. All Interface and the functions apply parameters please overview the following description of the paragraph.

Some function of the Fan Coil Unit Controller is the same. So, following paragraph will description of the function in detail.

3.1 Database functions Overview

The following table provide an overview of the functions and some parameters with the Fan Coil Unit Controller:

Function	Description
General	Supported functions, operation, channel select
Fan/Fan coil controller	Fan, Heating, Cooling, Heating and Cooling
System type	<i>2-pipe system:</i> There is one single water circuit that is filled with cooling or heating medium according to the season. <i>4-pipe system:</i> The system consists of two separate water circuits for heating and cooling.
Actual temperature	Read actual temperature via the KNX/EIB or local sensor, response and monitoring the temperature
Setpoint	Base setpoint temperature, different operation mode (Comfort mode, Standby mode, Night mode, Frost/heat Protection mode) corresponding to different setpoint temperature.
Fan (Relay or 0-10v)	3-speed fan, Automatic or manual fan control
Heating valve (Relay or 0-10v)	Base settings for heating valve (Electrothermal valve or Proportional valve)
Cooling valve (Relay or 0-10v)	Base settings for cooling valve (Electrothermal valve or Proportional valve)
Heating/Cooling valve (Relay or 0-10v)	Base valve settings for 2-pipe systems (Electrothermal valve or Proportional valve)
Function status	Response fan status and valve position status
Floor heating	---
Slave clock	Used for floor heating time synchronized.
Actual temperature	Read actual temperature via the KNX/EIB or local sensor, response and monitoring the temperature
Operation mode	Base setting for the operation mode setpoint temperature.(Normal mode,Day mode,Night mode, Timer mode)
Valve	Base settings for floor heating valve

Switch controller	Use of auxiliary relay
Time function	Staircase lighting and ON/OFF delay
	Statistics total ON time
	Voltage recovery state and Voltage fail state

3.2 Function parameter “General”

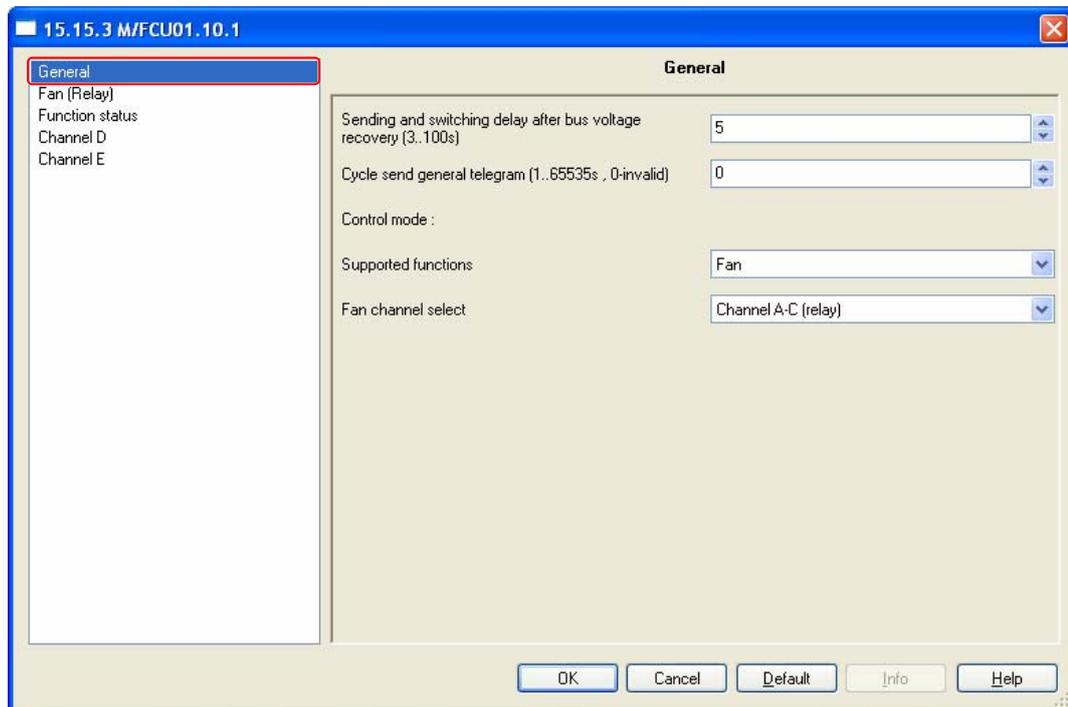


Fig. 1: “General” parameter window

In the parameter of the general windows can set the control mode and other parameters.

--- Sending and switching delay after bus voltage recovery [3..100s]

Options: **3...100s**

Telegrams are only received during the send and switching delay. The telegrams are not processed, however, and the outputs remain unchanged, no telegrams are sent on the bus.

After the sending and switching delay, telegrams are sent and the state of the outputs are set to correspond to the parameterisation or the communication object values.

--- Cycle send general telegram (1..65535s,0-invalid)

The range of the parameter is 0 to 65535s. Zero of parameter disable the function , other of parameter enable this function

Options:0...65535s

The parameter set to nonzero, Device will send a telegram data cyclically when time out. Send the value alternately between 0 and 1.

Control mode**--- Supported functions**

In the *General* parameter window, the basic settings for the Fan Coil Unit Controller which affect the device and all its outputs can be defined. The Fan Coil Unit Controller has five control modes. You can select the one of them. Through functional selection and download the database to the device, and device will work in accordance with the selected function.

Options:**Fan**

Heating

Cooling

Heating and cooling

Floor heating

Fan : The Fan Coil Unit Controller has fan function only. The free channels are available as independent switch outputs.

Heating: The Fan Coil Unit Controller has fan and heating functions. The free channels are available as independent switch outputs.

Cooling: The Fan Coil Unit Controller has fan and cooling functions. The free channels are available as independent switch outputs.

Heating and cooling: The Fan Coil Unit Controller has fan, heating and cooling functions. The free channels are available as independent switch outputs.

Floor heating: The Fan Coil Unit Controller has maximum seven channels floor heating. The free channels are available as independent switch outputs.

Fan, Heating or Cooling functions are the same with **Heating and Cooling** functions. So, the following paragraph will description of the **Heating and Cooling** and **Floor heating** functions in detail.

3.3 Function parameter “Heating and Cooling”

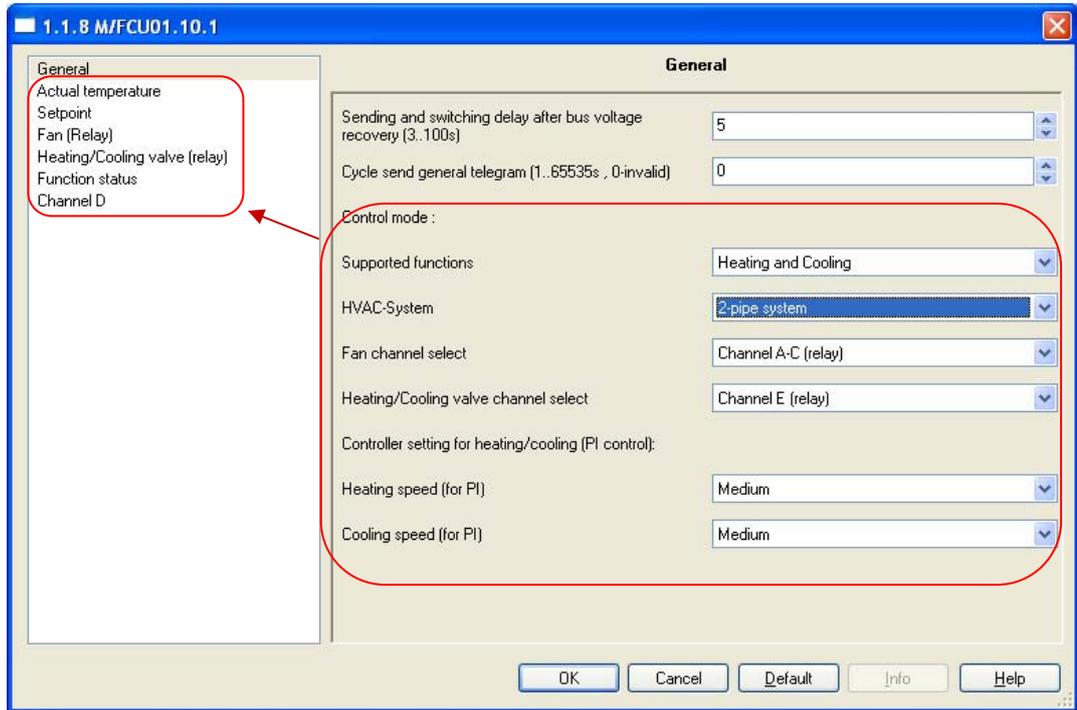


Fig.2: “Heating and Cooling” 2-pipe system parameter window

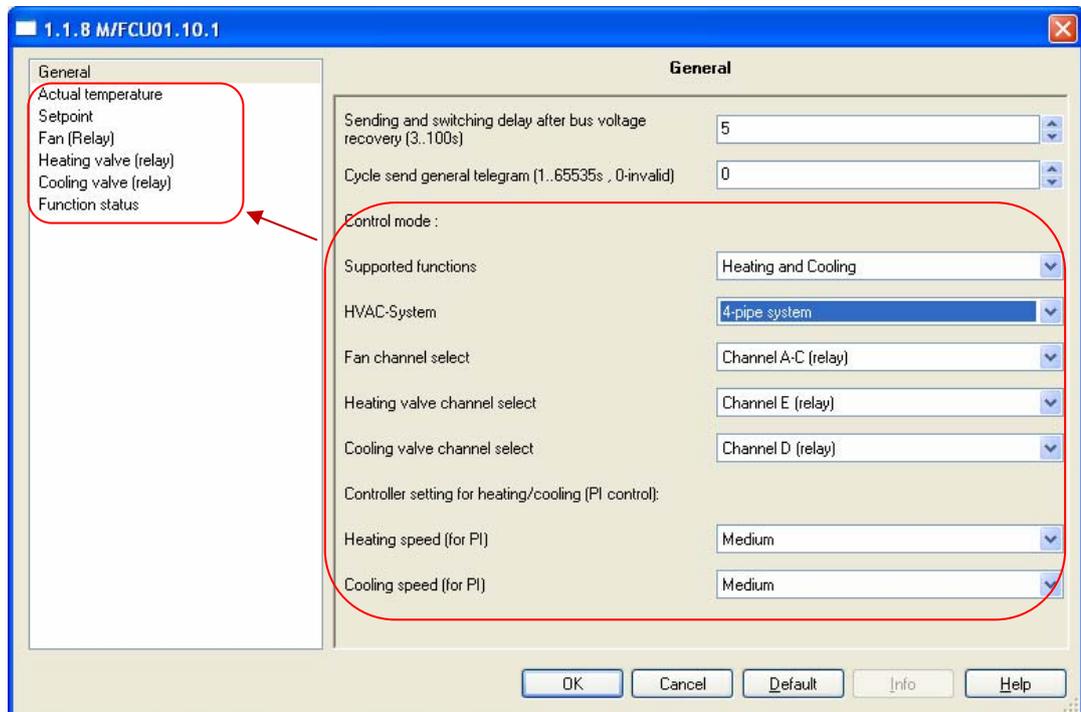


Fig.3: “Heating and Cooling” 4-pipe system parameter window

--- HVAC-System

Options: **2-pipe system**
4-pipe system

2-pipe system: There is one single water circuit that is filled with cooling or heating medium according to the season.

The following points must be observed for use in a 2 pipe heating/cooling system:

- In the 2-wire system heating and cooling mediums (depending on the season) are fed through the same channels and controlled by the same valve.
- The switchover between heating and cooling mediums is performed by the system and must therefore be passed on to the controller.

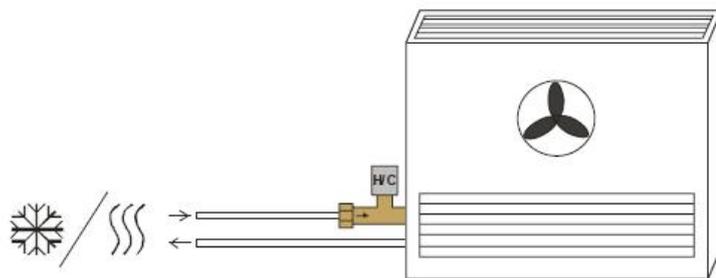


Fig.4: 2-pipe system

4-pipe system: The system consists of two separate water circuits for heating and cooling

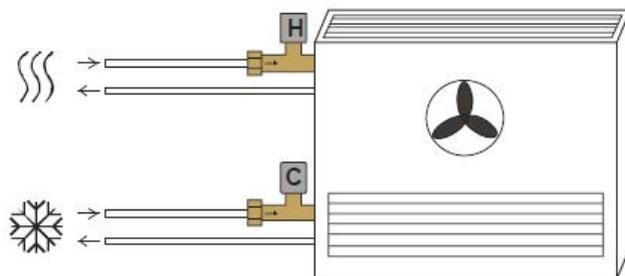


Fig.5: 4-pipe system

--- Fan channel select

The Fan Coil Unit Controller has two ways of the fan channel output. According to the fan characteristic choose corresponding channel.

Options: **Channel A-C (relay)**
Channel F (0-10V)

Channel A-C(relay) : Channels A ,B and C with 3-Speed fan relay output. The free channels are available as independent switch outputs.

Channel F(0-10V): This channel is an analogue signal (0-10 V) used to controls fan speed.

--- Heating/Cooling valve channel select

Only warm or only cold water is supplied centrally to the pipe system (2-pipe system). Depending on this setting one control value acts on one valve. According to the valve characteristic choose corresponding channel.

Options:**Channel E (relay)**
Channel G (0-10V)

Channel E (relay): This channel is relay output, suitable for electrothermal valve drives.

Channel G (0-10V): This channel is an analogue signal (0-10 V) output, suitable for proportional valve drives.

--- Heating valve channel select

Only warm water is supplied centrally to the pipe system (4-pipe system or heating only system). According to the valve characteristic choose corresponding channel.

Options:**Channel E (relay)**
Channel G (0-10V)

Channel E (relay): This channel is relay output, suitable for electrothermal valve drives.

Channel G (0-10V): This channel is an analogue signal (0-10 V) output, suitable for proportional valve drives.

--- Cooling valve channel select

Only cold water is supplied centrally to the pipe system (4-pipe system or cooling only system). According to the valve characteristic choose corresponding channel.

Options:**Channel D (relay)**
Channel F (0-10V)

Channel D (relay): This channel is relay output, suitable for electrothermal valve drives.

Channel F (0-10V): This channel is an analogue signal (0-10 V) output, suitable for proportional valve drives.

Controller setting for heating/cooling (PI control)**--- Heating speed (for PI)**

if you have sufficient knowledge in heating technology so that the appropriate settings are carried out correctly. The options are suitable for standard applications. It is only effective in valve types of control is “*PWM control*” or “*Continuous-acton control*”

Options:**Lower**

Low

Medium

Fast

Faster

Lower: Setting the PI controller response to lower for heating.

Low: Setting the PI controller response to low for heating.

Medium: Setting the PI controller response to medium for heating.

Fast: Setting the PI controller response to fast for heating.

Faster: Setting the PI controller response to faster for heating.

--- Cooling speed (for PI)

if you have sufficient knowledge in cooling technology so that the appropriate settings are carried out correctly. The options are suitable for standard applications. It is only effective in valve types of control is “*PWM control*” or “*Continuous-acton control*”

Options:**Lower**

Low

Medium

Fast

Faster

Lower: Setting the PI controller response to lower for cooling.

Low: Setting the PI controller response to low for cooling.

Medium: Setting the PI controller response to medium for cooling.

Fast: Setting the PI controller response to fast for cooling.

Faster: Setting the PI controller response to faster for cooling.

3.3.1 Actual temperature

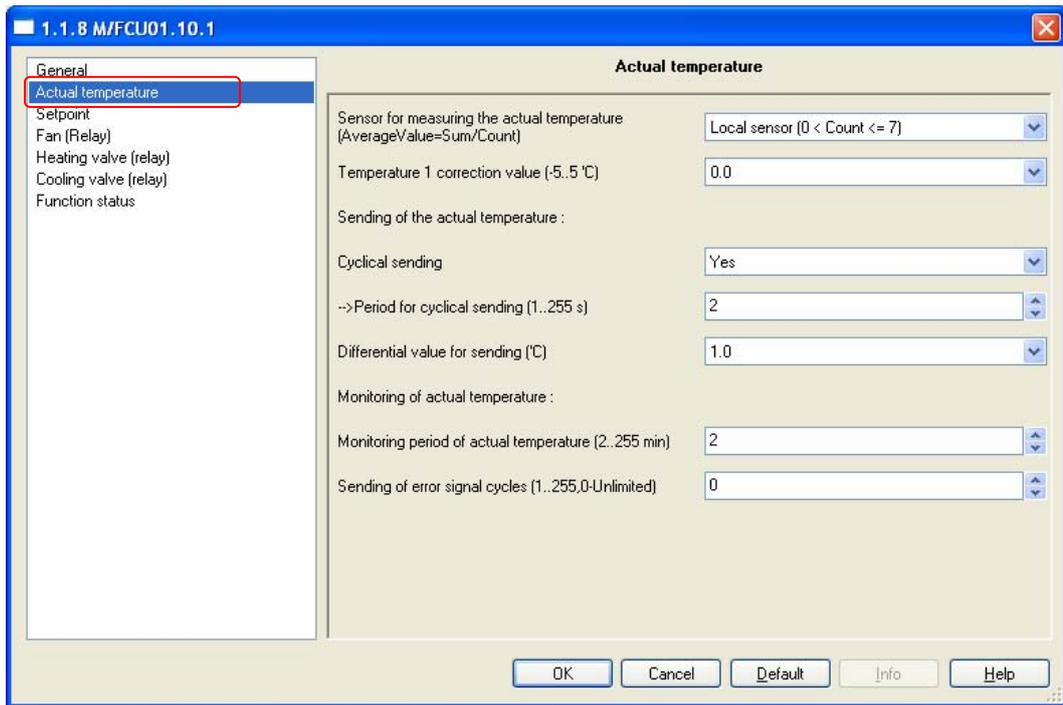


Fig.6: “Actual temperature” parameter window

--- **Sensor for measuring the actual temperature
(AverageValue = Sum / Count)**

Setting the temperature sensor.

Options: **Local sensor (0 < Count <= 7)**

One sensor via EIB (Count = 1)

Two sensor via EIB (Count = 2)

Local sensor (0 < Count <= 7): the temperature sensor TS/C 1.0 is must connected to the Fan Coil Unit Controller. Maximum can connect seven temperature sensor, the results take the average (AverageValue = Sum / Count). In this case, the three parameters for *Sending of the actual temperature* become visible.

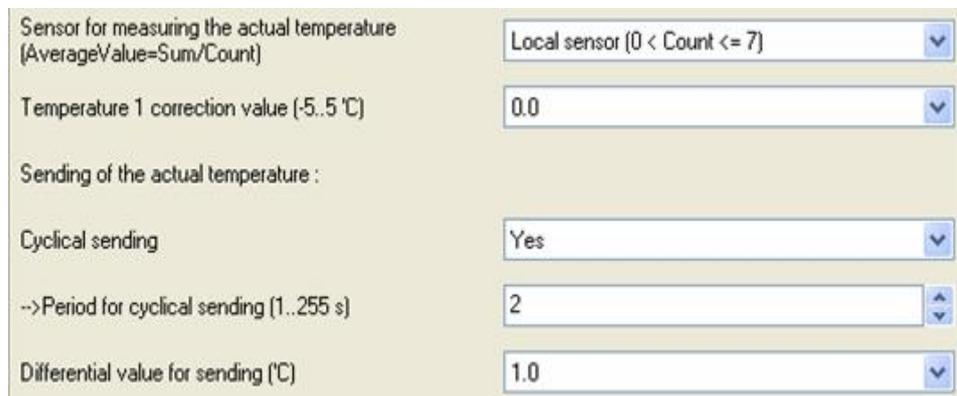


Fig.7: “Local sensor (0 < Count <= 7)”

One sensor via EIB (Count = 1): The temperature is received via the KNX/EIB. Object 10 is the information input for KNX/EIB sensors.

Sensor for measuring the actual temperature (AverageValue=Sum/Count)	One sensor via EIB (Count = 1)
Temperature 1 correction value (-5..5 °C)	0.0
Read temperature cyclically via EIB	Yes
-->Period for cyclical reading (1..255 s)	2

Fig.8: “One sensor via EIB (Count = 1)”

Two sensor via EIB (Count = 2): The temperature is received via the KNX/EIB. Object 10 and 11 are the information input for KNX/EIB sensors. The results take the average (AverageValue = Sum / Count).

Sensor for measuring the actual temperature (AverageValue=Sum/Count)	Two sensor via EIB (Count = 2)
Temperature 1 correction value (-5..5 °C)	0.0
Temperature 2 correction value(-5..5 °C)	0.0
Read temperature cyclically via EIB	Yes
-->Period for cyclical reading (1..255 s)	2

Fig.9: “Two sensor via EIB (Count = 2)”

--- Temperature 1 correction value (-5..5 °C)

Options [°C]:-5.0...5.0 (0.0)

Correction of the value measured by the temperature sensor TS/C 1.0 or the actual value received via the KNX/EIB.

--- Temperature 2 correction value (-5..5 °C)

Options [°C]:-5.0...5.0 (0.0)

Correction of the value measured by the actual value received via the KNX/EIB. This parameter is only visible if the option “Two sensor via EIB (Count = 2)” has been selected for the parameter *Sensor for measuring the actual temperature (AverageValue = Sum / Count)*.

Sending of the actual temperature

--- Cyclical sending

Options:NO

YES

Activation of the cyclical transmission function for the actual temperature. This parameter is only visible if the option “Local sensor (0 < Count <= 7)” has been selected for the parameter *Sensor for measuring the actual temperature (AverageValue = Sum / Count)*.

→Period for cyclical sending (1..255 s)

Options:1..255s (2)

Setting the cyclical transmission period for the actual temperature. This parameter is only visible if the option “YES” is selected for the parameter *Cyclical sending*.

→ Differential value for sending ('C)

Options:0.5..3 (1)

Setting the temperature change at which the actual temperature is sent in addition to being sent after a change in value. This parameter is only visible if the option “Local sensor (0 < Count <= 7)” has been set for the parameter *Sensor for measuring the actual temperature(AverageValue =Sum / Count)*.

--- Read temperature cyclically via EIB

Options:NO

YES

Activation of the cyclical reading function for the actual temperature via KNX/EIB. This parameter is only visible if the option “One sensor via EIB (Count = 1)” or “Two sensor via EIB (Count = 2)” is set for the parameter *Sensor for measuring the actual temperature(AverageValue =Sum / Count)*.

--- -->Period for cyclical reading (1..255 s)

Options:1..255s (2)

Setting the cyclical reading period for the actual temperature via KNX/EIB. This parameter is only visible if the option “YES” is selected for the parameter *Read temperature cyclically via EIB*.

Monitoring of actual temperature**--- Monitoring period of actual temperature (2..255 min)**

Options:2..255 min (2)

Setting the monitoring period for the actual temperature (local temperature sensor or via the KNX/EIB).

--- Sending of error signal cycles (1..255,0-Unlimited)

Options:0..255 (0)

For setting the send repetition in the event of an error message. If the option “1..255” is selected, the error signal is only sent 1..255 counts if there is a change in the object value. If the option “0-Unlimited” is set, the object value is sent according to the parameterised *Monitoring period of actual temperature (2..255 min)*.

3.3.2 Setpoint

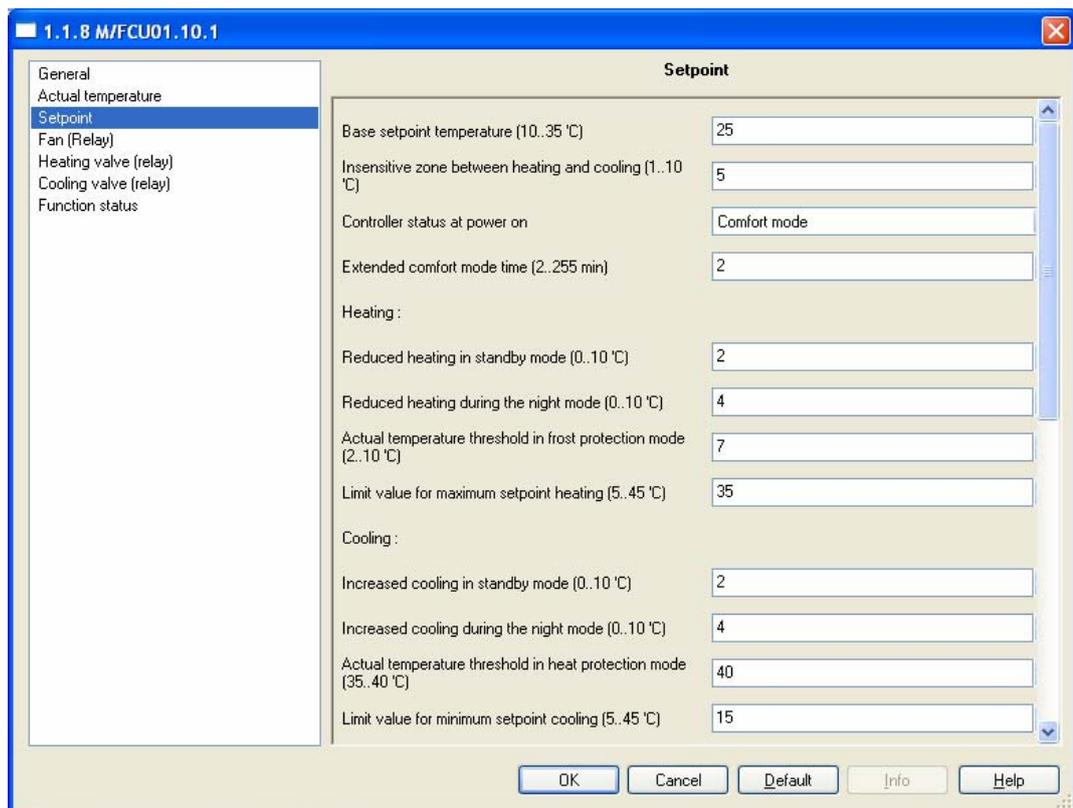


Fig.10: "Setpoint" parameter window

--- Base setpoint temperature (10..35 °C)

Options: 10..35 °C (25)

Setting the base setpoint temperature. This is stored in non-volatile memory. Can be modified with a telegram to the communication object "Setpoint – Base setpoint temperature".

--- Insensitive zone between heating and cooling (1..10 °C)

Options: 1..10 °C (5)

Setting the insensitive zone in degrees centigrade. The insensitive zone is a buffer area between heating and cooling operation. Neither heating nor cooling takes place within this insensitive zone. Without this buffer zone, the system would switch continuously between heating and cooling. As soon as the set point value has been under-run, the heating is activated and the set point value would not be achieved. If cooling were then to be started immediately, the temperature would fall below the set point value and switch on the heating again. This parameter is only visible if the option "4-pipe system" is selected for the parameter *HVAC-System*.

--- Controller status at power onOptions: **Unchanged****Comfort mode****Standby mode****Night mode****Frost/heat protection**

When the installation is switched on, the device is set to the required HVAC mode. During operation, a selection can be made via the KNX/EIB. The ON commands are entered via the following objects:

Comfort mode 31

Standby mode: 32

Night mode: 33

Frost protection: 34

--- Extended comfort mode time (2..255 min)Options: **2..255 min (2)**

Setting the duration of the comfort extension mode. If the device has been switched from comfort mode to night mode, the comfort extension is activated for the parameterised time by a telegram to the communication object “HVAC mode– ON command for comfort mode” and then switched back automatically to night mode.

Heating**--- Reduced heating in standby mode (0..10 °C)**Options: **0..10 °C (2)**

For setting the temperature reduction when heating in standby mode. The reduction in temperature is calculated starting with the base setpoint temperature.

--- Reduced heating during the night mode (0..10 °C)Options: **0..10 °C (4)**

For setting the temperature reduction when heating during night mode. The reduction in the temperature is calculated starting with the base setpoint temperature.

--- Actual temperature threshold in frost protection mode (2..10 °C)Options: **2..10 °C (7)**

Setting the minimum frost protection temperature. When this temperature is reached, the heating is automatically turned up to prevent the temperature falling below the threshold value.

--- Limit value for maximum setpoint heating (5..45 'C)

Options: 5..45 'C (35)

Setting the maximum setpoint temperature for heating. The room is not heated above this temperature.

Cooling

--- Increased cooling in standby mode (0..10 'C)

Options: 0..10 'C (2)

For setting the temperature increase when cooling in standby mode. The increase in temperature is calculated starting with the base setpoint temperature.

--- Increased cooling during the night mode (0..10 'C)

Options: 0..10 'C (4)

For setting the temperature increase when cooling during night mode. The increase in the temperature is calculated starting with the base setpoint temperature.

--- Actual temperature threshold in heat protection mode (35..40 'C)

Options: 35..40 'C (40)

Setting the maximum heat protection temperature. When this temperature is reached, the cooling is automatically switched on to prevent the threshold value from being exceeded.

--- Limit value for minimum setpoint cooling (5..45 'C)

Options: 5..45 'C (15)

Setting the minimum setpoint temperature for cooling. The room is not cooled below this temperature.

The toggling between the HVAC modes is carried out via communication objects:

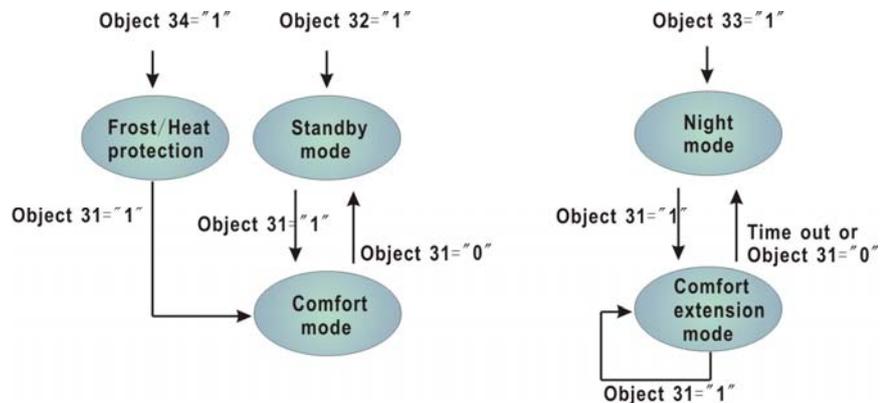


Fig.11: HVAC mode selection via communication objects

Object 31: HVAC mode – ON CMD for comfort mode
Object 32: HVAC mode – ON CMD for standby mode
Object 33: HVAC mode – ON CMD for night mode
Object 34: HVAC mode – ON CMD for building protection (Frost/Heat protection) mode
Time out: Parameterised *Extended comfort mode time* has elapsed

The difference between comfort mode and comfort extension is that the toggling from comfort mode to another mode is triggered via a communication object while switching from comfort extension mode to another mode also takes place automatically once the parameterized *Extended comfort mode time* has elapsed.

Calculation of the setpoints for the various HVAC modes:

Comfort mode:

- * Heating setpoint temperature = Base setpoint temperature
- * Cooling setpoint temperature = Base setpoint temperature

In the 4-pipe system automatic heating/cooling mode:

- * Cooling setpoint temperature = Base setpoint temperature +
Insensitive zone

Standby mode:

- * Heating setpoint temperature = Base setpoint temperature - Reduced heating in standby mode
- * Cooling setpoint temperature = Base setpoint temperature + Increased cooling in standby mode

In the 4-pipe system automatic heating/cooling mode:

- * Cooling setpoint temperature = Base setpoint temperature +
Insensitive zone + Increased cooling in standby mode

Night mode:

- * Heating setpoint temperature = Base setpoint temperature - Reduced heating during night mode
- * Cooling setpoint temperature = Base setpoint temperature + Increased cooling during night mode

In the 4-pipe system automatic heating/cooling mode:

- * Cooling setpoint temperature = Base setpoint temperature +
Insensitive zone + Increased cooling during night mode

Frost/Heat protection:

- * Heating setpoint temperature = Threshold value for frost protection
- * Cooling setpoint temperature = Threshold value for heat protection

The setpoint temperature is restricted by the setpoint limit value. The setpoint limit for heating defines the maximum temperature for heating the room. The setpoint limit for cooling defines the minimum temperature for cooling the room.

3.3.3 Fan

The fan coil actuator can be adapted very flexibly to the specific fan coil application required by means of parameter configurations. Thus initially the number of fan level required for the connected devices can be defined. Fan coil actuator has two channel can choose, one of channel is a relay output, the other is an analogue signal (0-10 V) output. According to the fan characteristic choose corresponding channel.

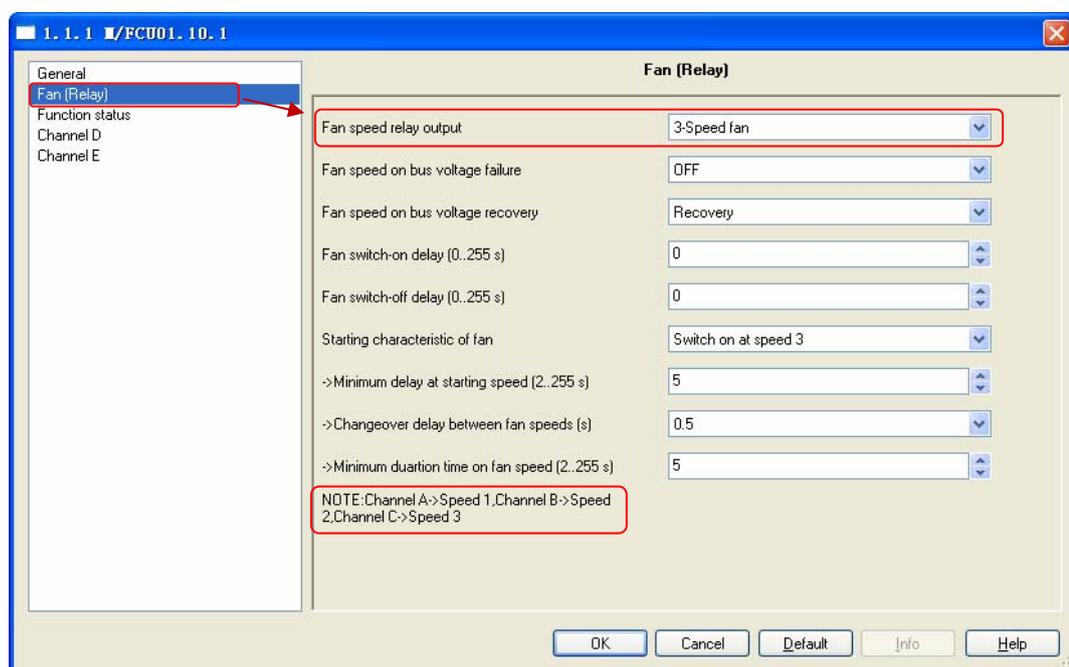


Fig.12: “Fan(relay)” parameter window

--- Fan speed relay output

Setting the number of fan speeds. This parameter is only visible if the option “Channel A-C (relay)” has been selected for the parameter *Fan channel select*. The maximum number of usable fan levels depends on this parameter. In the configuration with *Channel A-C (relay)* a maximum of 3 fan levels can be used. Fan level outputs of a fan coil channel which are not used can optionally be used as switching outputs with a simple switching function.

Options: **1-Speed fan**

2-Speed fan

3-Speed fan

1-Speed fan: The fan has only 1-speed connect to the channel A (Channel A -> Speed 1).

2-Speed fan: The fan has 2-speed connect to the channel A and channel B (Channel A -> Speed 1 , Channel B -> Speed 2).

3-Speed fan: The fan has 3-speed connect to the channel A, channel B and channel C (Channel A -> Speed 1, Channel B -> Speed 2, Channel C -> Speed 3).

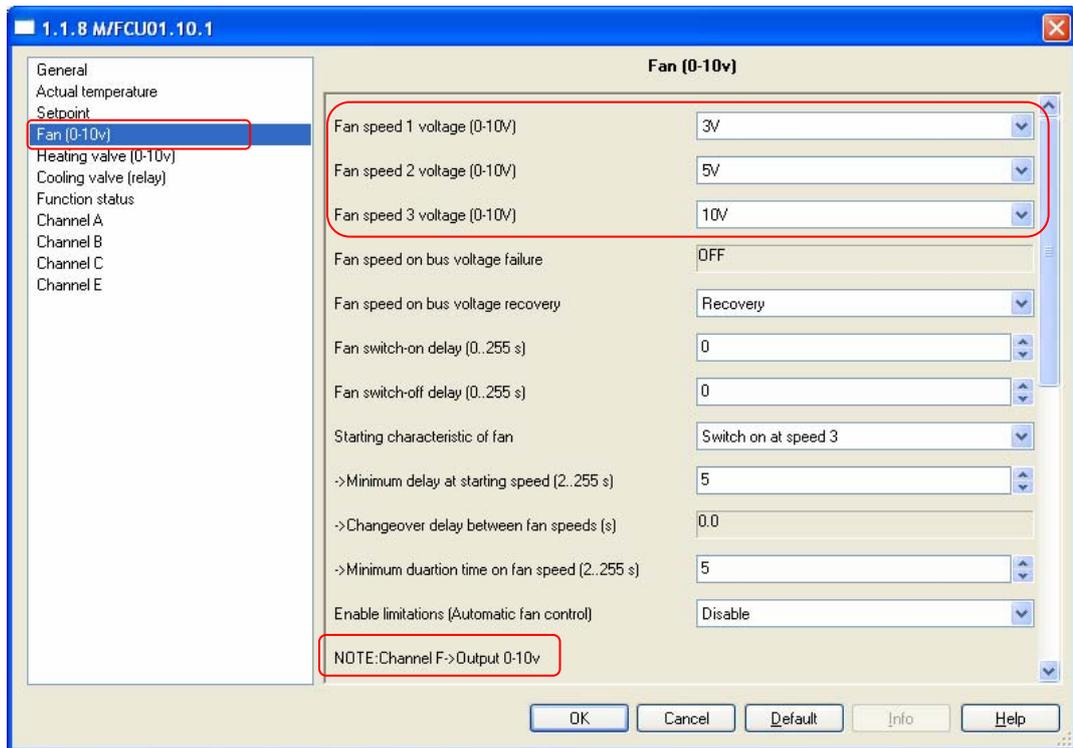


Fig.13: “Fan(0-10v)” parameter window

--- **Fan speed 1 voltage (0-10V)**

--- **Fan speed 2 voltage (0-10V)**

--- **Fan speed 3 voltage (0-10V)**

Options:0v..10v

Setting the voltage of fan speeds. This parameter is only visible if the option “Channel F (0-10v)” has been selected for the parameter *Fan channel select*. The fan has connect to the channel F.

--- **Fan speed on bus voltage failure**

Options:Unchanged

OFF

The behavior of the fan with a bus voltage failure is defined here.

unchanged: The fan speeds of the fan remain unchanged.

OFF: The fan is switched off.

--- Fan speed on bus voltage recovery

Options: Recovery

OFF

1

2

3

Set the speed of the fan when voltage recovery.

Recovery: After bus voltage recovery, the fan speed will be back to the speed of the power-down previous.

Off: The fan will switch OFF after bus voltage recovery.

1, 2 or 3: The fan switches to fan speed 1, 2 or 3.

--- Fan switch-on delay (0..255 s)

Options: 0..255

Set the delay of switch-on. The range is 0...255.

--- Fan switch-off delay (0..255 s)

Options: 0..255

Set the delay of switch-off. The range is 0...255.

--- Starting characteristic of fan

Options: Switch on at speed 1

Switch on at speed 2

Switch on at speed 3

Setting the speed at which the fan switches on. To ensure that the fan motor starts reliably, it is advisable to start at a higher speed initially, depending on the type, in order to maintain a higher torque at start-up. Once the *Minimum delay at starting speed* has elapsed, the fan is switched to the speed that corresponds to the control value. Fig. 7 shows an example of the response for the option “switch on at speed 3”.

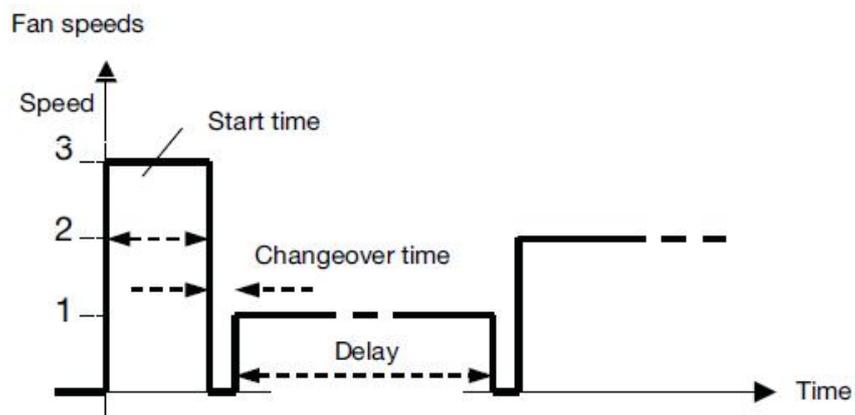


Fig.14: Switch fan on at speed 3

--- **Minimum delay at starting speed(2...255s)**

Options: **2...255s**

The starting time of the fan is entered here which can vary from fan to fan depending on the inertia of the rotating components.

--- **Changeover delay between fan speeds(s)**

Options: **0.5...10s**

Setting the changeover delay between the fan speeds. This parameter is only effective if the option "Channel A-C(relay)" has been set for the parameter *Fan channel select*.

--- **Minimum duration time on fan speed (2...255 s)**

Options:**2...255s**

Used to prevent frequent toggling between fan speeds which can be detrimental to comfort levels.

--- **Enable limitations (Automatic fan control)**

Options:**Disable**

Enable

Disable: Disable the fan limitations function.

Enable: Further parameters become visible, set as follows

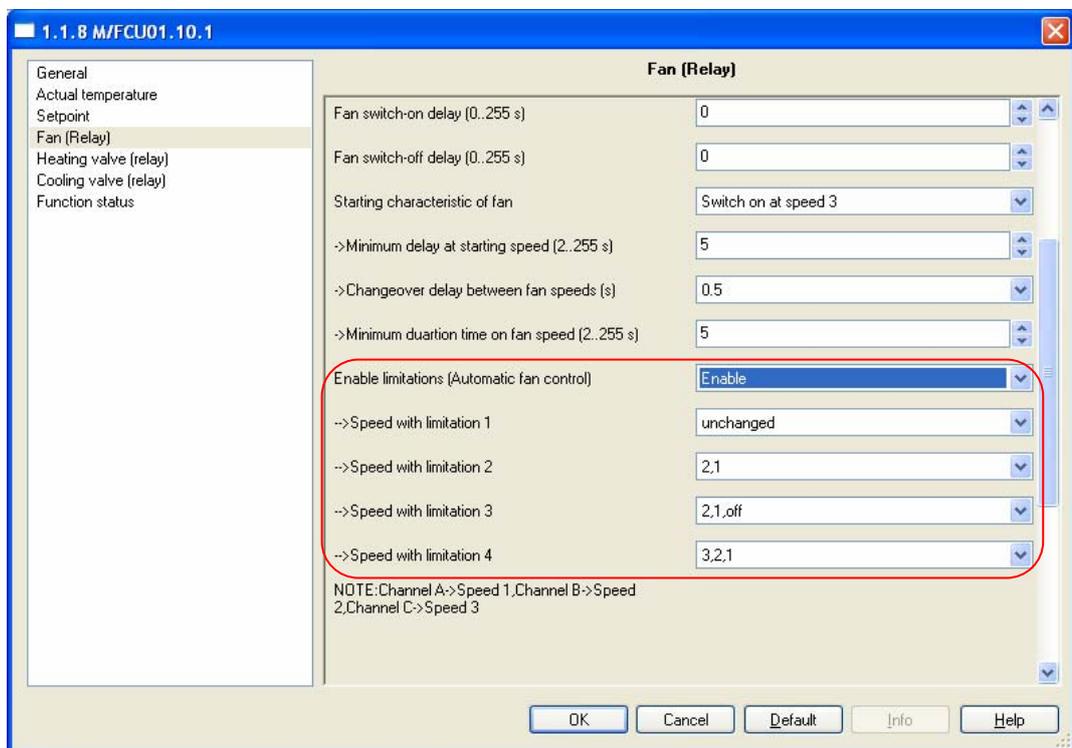


Fig.15: Enable limitations (Automatic fan control)

At the same time, four communication objects for limitation of the fan speed are enabled:

Limitation 1, e.g. for frost/heat protection

Limitation 2, e.g. for comfort operation

Limitation 3, e.g. for night shutdown

Limitation 4, e.g. for standby operation

Speed ranges (limitations) are defined for the fan with the speed limitation function that may not be exceeded or undershot. Four limitations are available. This can be used for example for the control of various operating modes, e.g. frost/heat protection, comfort, night shut down and standby. In normal cases the thermostat takes these operating modes into account in its control variable for the actuator.

Important

The parameterised starting behaviour which is a technical characteristic of the fan has a higher priority than a limitation operation, i.e. if a limitation is activated in fan speed 2 and a start-up behaviour is parameterised via fan speed 3, the following behaviour will result: The fan is in the OFF state and receives a control signal for fan speed 1. Initially the fan operates at fan speed 3 (start-up speed) and then proceeds to fan speed 2 which is defined by the limitation. The actual required fan speed 1 will not be achieved due to the limitation.

When automatic mode is exited, e.g. by a manual action, the limitations become inactive. The set limitations are reactivated after automatic operation is reactivated.

The following points apply for limitations:

- *The fan speed and valve position can be parameterised independently.
- *The limitation need not necessarily apply to one fan speed only. It can also encompass another range of the fan speeds, i.e. only certain fan speeds can be set if the limitation is active. In this way a limited control is also possible.
- *The limitation is activated if a telegram with the value 1 is received on the limitation object. The limitation is deactivated if a telegram with the value 0 is received on the limitation object. A manual action ends automatic mode.
- *If a limitation is activated, the Fan Coil Controller switches to the parameterised fan speed regardless of the control value. If during the activation of the limitation another fan speed or a fan speed outside the range of the “limitation range” is set, the required fan speed or the limit fan speed of the range is set.
- *After switch off of the limitations, the fan speed and the communication objects for valve control are recalculated and executed, This means that during limitation the actuator operates normally in the background, the

outputs are not changed and implementation only occurs after the end of limitation.

There are the same parameters and priority for each of the individual four limitations used to limit the fan speeds. If several ON commands 1 are received by the various fan speed limitation objects, the value that was last received for the fan limitation control is decisive. This also applies for the OFF command 0.

- → **Speed with limitation 1**
- → **Speed with limitation 2**
- → **Speed with limitation 3**
- → **Speed with limitation 4**

Options: **3, 2, 1, OFF**
unchanged
OFF
1
1, OFF
2
2, 1
2, 1, OFF
3
3, 2
3, 2, 1

With this parameter you set the fan speed that is set with active limitation, and the fan speed is set with automatic control.

3, 2, 1, OFF: Everything is possible.

Unchanged: The state is retained.

OFF: Off.

1: limited to speed 1.*

1, OFF: limited to speed 1 and off.

2: limited to speed 2.*

2, 1: limited to speed 2 and 1.

2, 1, OFF: limited to speed 2, 1 and off.

3: limited to speed 3.*

3, 2: limited to speed 3 and 2.

3, 2, 1: limited to speed 3, 2 and 1.

Note: * The control value is ignored.

3.3.4 Valve

The Fan Coil Unit Controller can control the following valve drives:

- * Electromotive valve drives: Electromotive valve drives close and open valves via a small electric motor. It is available as proportional valve drives. Proportional valve drives are controlled via an analogue signal (0...10 V).
- * Electrothermal valve drives: Electrothermal valve drives are adjusted via the heat expansion of a material as a result of a flow of electrical current. Electrothermal valve drives are regulated via two-step control or pulse width modulation.

3.3.4.1 Heating/Cooling valve (relay)

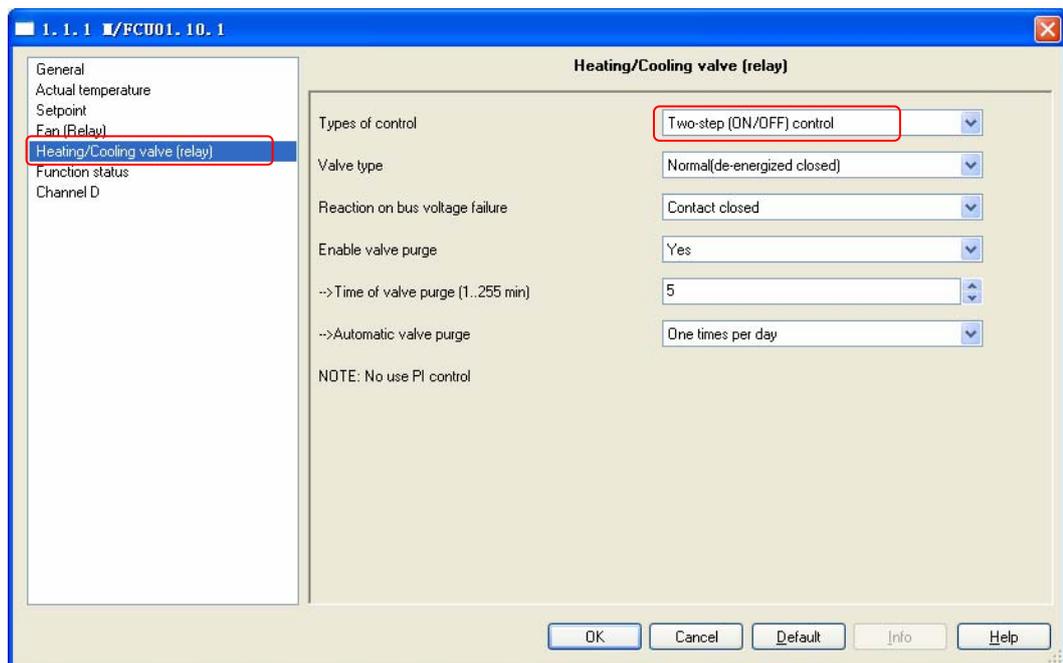


Fig.16: “Heating/Cooling valve (relay)” *Two-step(ON/OFF) control* parameter window
 This parameter window is only visible if the option “Channel E(relay)” has been selected for the parameter *Heating/Cooling valve channel select* in the 2-pipe system.

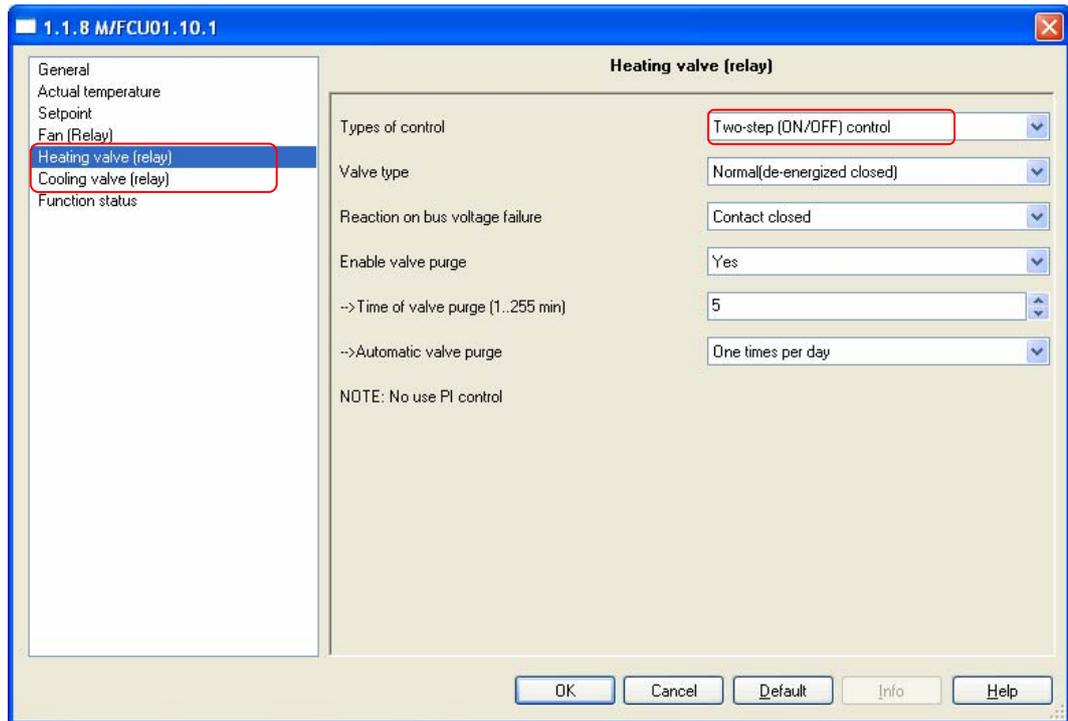


Fig.17: “Heating valve (relay)” *Two-step(ON/OFF) control* parameter window
 The parameter windows “Heating/Cooling valve (relay)”, “Heating valve (relay)” and “Cooling valve (relay)” are largely similar. Only the default values for the cycle time differ from each other.

---Types of control

Options:**Two-step(ON/OFF)control**
PWM control

Two-step(ON/OFF)control: the valve is fully opened if the room temperature falls below a lower limit value while the valve is fully closed if the room temperature exceeds an upper limit value. This types of control is not used PI control.

Upper limit value=Setpoint temp. + 1°C

Lower limit value=Setpoint temp. – 1°C

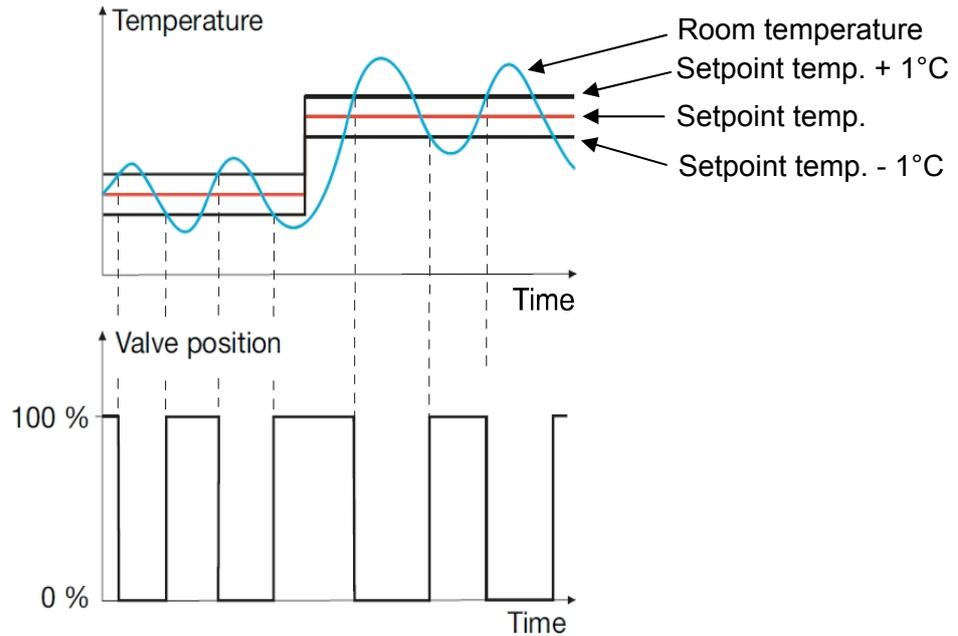


Fig.18: Diagram for 2-step control

PWM control: The control value is fixed for a cyclic period and converted into the valve opening duration. For example, the control value 20 % is converted at a cyclic period of 15 minutes into a valve opening time of 3 minutes. The control value 50 % produces a valve opening time of 7.5 minutes. This types of control is used PI control. In the following fig19. is the PWM control diagram:

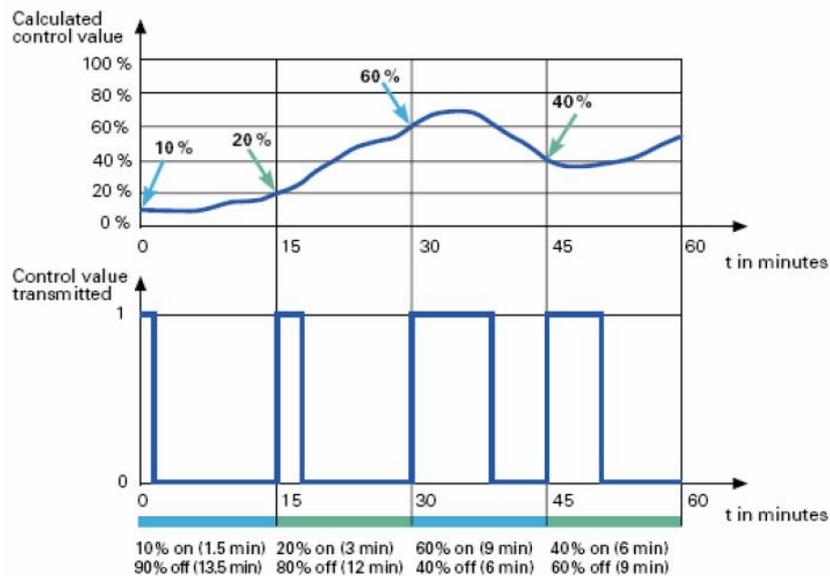


Fig.19: PWM control diagram

---Valve type

Options:**Inverted(de-energized opened)**
Normal (de-energized closed)

Setting the control direction of the valve.

---Reaction on bus voltage failure

Options:**Contact unchanged**
Contact open
Contact closed

Contact unchanged: No change of the contact position.

Contact opened: The contact is opened with bus voltage failure.

Contact closed: The contact is closed with bus voltage failure.

---Enable valve purge

Options:**NO**
Yes

NO: Disable valve purge.

YES: The 1 bit *Trigger valve purge* communication object is enabled.

With this parameter, the function of a valve purge of the output can be enabled. Regular purging of a heating valve can prevent deposits from forming in the valve area and restricting the valve function. At the same time it is assured that the heating element is purged which simplifies the bleeding of trapped air. This is particularly important at times when the valve position does not change very much. The valve is opened to the maximum during a valve purge. It can be triggered via the object *Trigger valve purge* and/or automatically at adjustable intervals. With the option *yes*, the objects *Trigger valve purge* and *Status valve purge* are enabled. Also the parameter *Time of valve purge in minutes (1...255)* and *Automatic valve purge* are enabled.

The screenshot shows a configuration window with three settings:

- Enable valve purge:** A dropdown menu set to "Yes".
- >Time of valve purge (1..255 min):** A numeric input field set to "5".
- >Automatic valve purge:** A dropdown menu set to "One times per day".

Fig.20: Enable valve purge

-->Time of valve purge(1..255min)

Options: **1..255min**

Set the time for the valve purge. In this time the valve is fully opened. When the time has elapsed, the state before the purge is re-established.

-->Automatic valve purge

Set the automatic valve purge frequency.

Options: **NO**

One times per day

One times per week

One times per month

One times per day: Automatic valve purge every day.

One times per week: Automatic valve purge every week.

One times per month: Automatic valve purge every month.

A purge can be initiated by the object *Trigger valve purge*. The counter for automatic purging starts to run when the parameter is loaded in the actuator. The time is reset each time it is downloaded. The time is reset as soon as purging is completed. This can occur either through automatic purging or via the object *Trigger valve purge*.

The following paragraph will description of the PWM control of the valve type in detail.

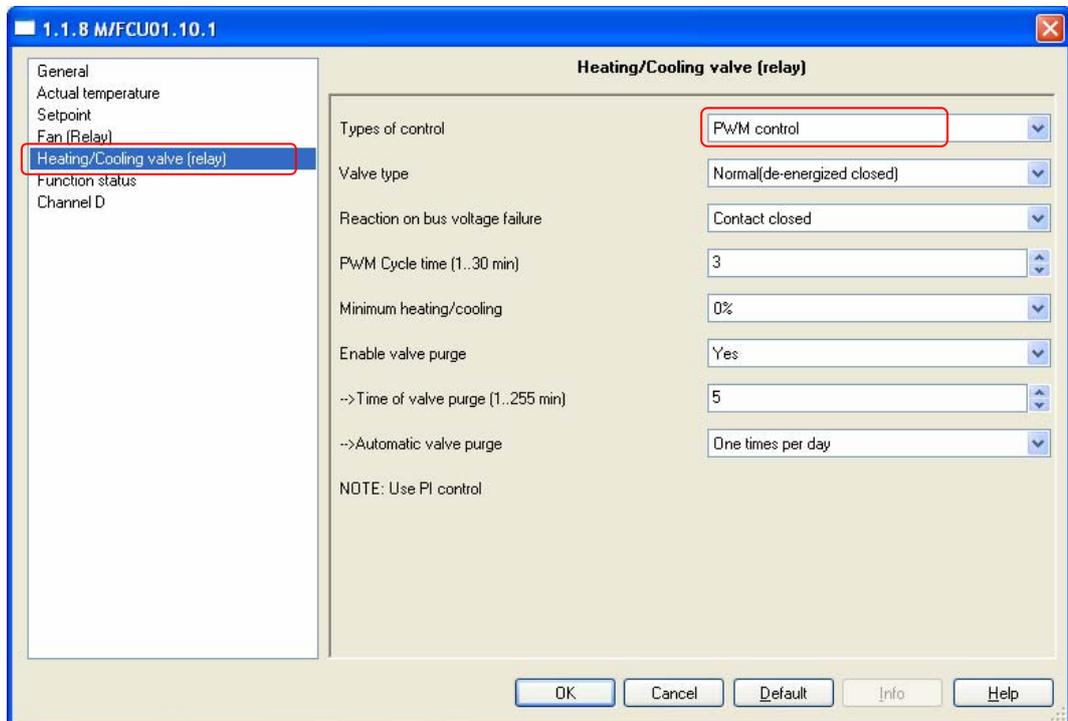


Fig.21: "Heating/Cooling valve (relay)" PWM control parameter window

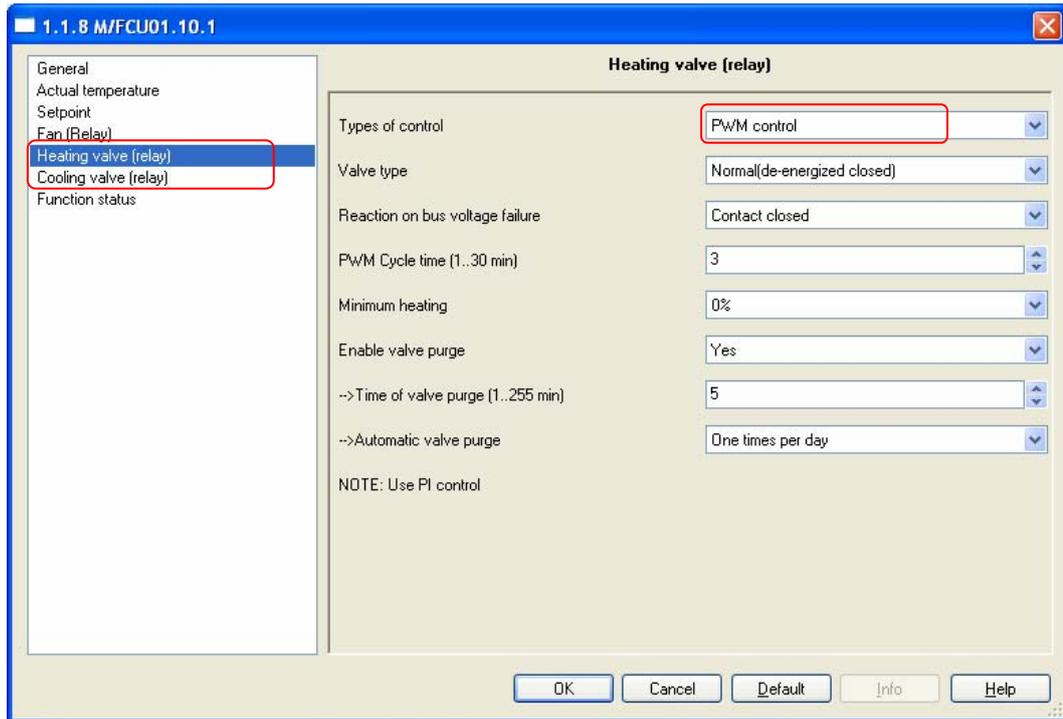


Fig.22: “Heating valve (relay)” PWM control parameter window

The parameter windows “Heating/Cooling valve (relay)”, “Heating valve (relay)” and “Cooling valve (relay)” with the both of control type functions are largely similar. Only the following functions differ from each other.




Fig.23: PWM control parameter

---PWM Cycle time(1..30min)

This is used to set the cycle time of the PWM control.
Options: **1..30min**

An actuation cycle consists of one on and one off process and forms a PWM period. Example: Actuating value= 20%, PWM time = 10 min: In an actuating cycle of 10 min, 2 min switched on and 8 min switched off (i.e. 20% on/ 80% off). To fully open an electrothermal control valve takes approximately 2-3 minutes. That is why a cycle time of less than 15 minutes is not practical.

If a PWM cycle time of 15 minutes has been selected, this means that 4 switching operations (switching on/of) occur each hour. 96 in a day; 3000 in a month. About 36,000 switching operations are achieved annually. With a relay life of 10⁵ switching operations, this means a switch actuator life of less than 3 years.

If however, the cycle time is set to just 3 minutes, this means about 150,000 switching operations annually, which normally means the life of the switch actuator would be less than a year.

This observation assumes an AC1 (practically ohmic load) switch loading at rated current. If the maximum number of switching operations for a purely mechanical relay loading is assumed, the life of the switch actuator is extended. This has an inherent risk, as the contact materials will wear prematurely and cannot safely guarantee conduction of current.

In the following table, conventional cycle times for control of various heating and air-conditioning systems are listed:

Heating system	Control type	Cycle time
Hot water Supply temperature 45 °C – 70 °C	PWM	15 minutes
Hot water Supply temperature < 45 °C	2-step PWM	- 15 minutes
Underfloor/wall heating	PWM	30-20 minutes
Electric underfloor heating	PWM	30-20 minutes
Electric fan heating	2-step	-
Electric convection heating	PWM 2-step	10-15 minutes -

---Minimum heating

Options: **0%,5%,10%,15%,20%,**

Minimum permissible valve setting with actuating value.

3.3.4.2 Heating/Cooling valve (0-10v)

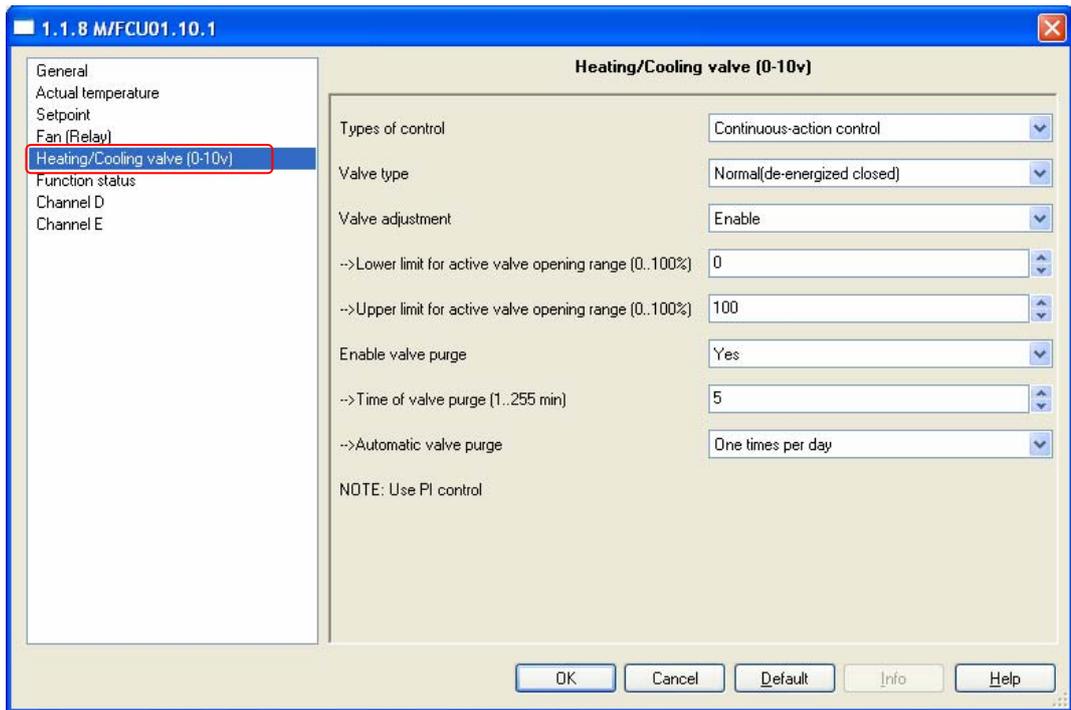


Fig.24: “Heating/Cooling valve (0-10v)” parameter window

This parameter window is only visible if the option “Channel G(0-10v)” has been selected for the parameter *Heating/Cooling valve channel select* in the 2-pipe system.

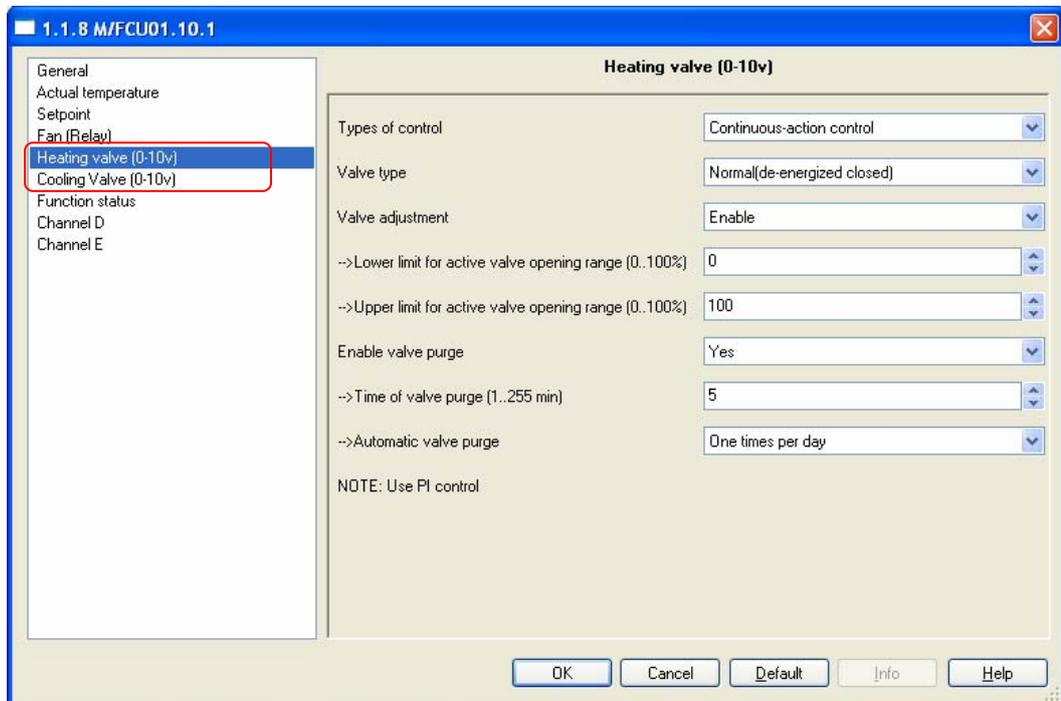


Fig.25: “Heating valve (0-10v)” parameter window

The parameter windows “Heating/Cooling valve (0-10v)” , “Heating valve (0-10v)” and “Cooling valve (0-10v)” are largely similar.

---Types of control

Options:**ON(10V)/OFF(0V) control**

Continuous-action control

ON(10V)/OFF(0V) control: the valve is fully opened (10v) if the room temperature falls below a lower limit value, while the valve is fully closed (0v) if the room temperature exceeds an upper limit value. This types of control is not used PI control. It used the same with *Two-step(ON/OFF)control*.

Upper limit value=Setpoint temp. + 1°C

Lower limit value=Setpoint temp. – 1°C

Continuous-action control: A continuous controller has a continuously changing control value which can output voltage between 0v to 10v, it can be used to activate proportional valve drives. The valve can thereby be fully opened, fully closed and moved to any intermediate position. This types of control is used PI control.

---Valve type

Options:**Inverted(de-energized opened)**

Normal (de-energized closed)

Setting the control direction of the valve.

---Valve adjustment

User-defined adjustment of the valve characteristics.

Options:**Disable**

Enable

Disable: Disable the valve adjustment.

Enable: Enable the valve adjustment.

Only select the option “Enable” if you have sufficient knowledge in heating and cooling technology so that the appropriate settings are carried out correctly. The option “Disable” is suitable for standard applications.

--- →Lower limit for active valve opening range (0..100%)

--- →Upper limit for active valve opening range (0..100%)

Options: **0..100%**

For setting the valve characteristic curve i.e. the valve position dependent on the control value.

---Enable valve purgeOptions:**NO****Yes****NO:** Disable valve purge.**YES:** The 1 bit *Trigger valve purge* communication object is enabled

With this parameter, the function of a valve purge of the output can be

enabled. Regular purging of a heating valve can prevent deposits from

forming in the valve area and restricting the valve function. At the same time

it is assured that the heating element is purged which simplifies the bleeding

of trapped air. This is particularly important at times when the valve position

does not change very much. The valve is opened to the maximum during a

valve purge. It can be triggered via the object *Trigger valve purge* and/orautomatically at adjustable intervals. With the option *yes*, the objects*Trigger valve purge* and *Status valve purge* are enabled. Also the parameter*Time of valve purge in minutes (1..255)* and *Automatic valve purge* are

enabled.

The screenshot shows a configuration window with three rows. The first row is 'Enable valve purge' with a dropdown menu set to 'Yes'. The second row is '-->Time of valve purge (1..255 min)' with a text input field containing the number '5'. The third row is '-->Automatic valve purge' with a dropdown menu set to 'One times per day'.

Fig.26: Enable valve purge

-->Time of valve purge(1..255min)Options: **1..255min**

Set the time for the valve purge. In this time the valve is fully opened. When the time has elapsed, the state before the purge is re-established.

-->Automatic valve purge

Set the automatic valve purge frequency.

Options:**NO****One times per day****One times per week****One times per month****One times per day:** Automatic valve purge every day.**One times per week:** Automatic valve purge every week.**One times per month:** Automatic valve purge every month.A purge can be initiated by the object *Trigger valve purge*. The counter for automatic purging starts to run when the parameter is loaded in the actuator.

The time is reset each time it is downloaded. The time is reset as soon as

purging is completed. This can occur either through automatic purging or via

the object *Trigger valve purge*.

3.3.5 Function status

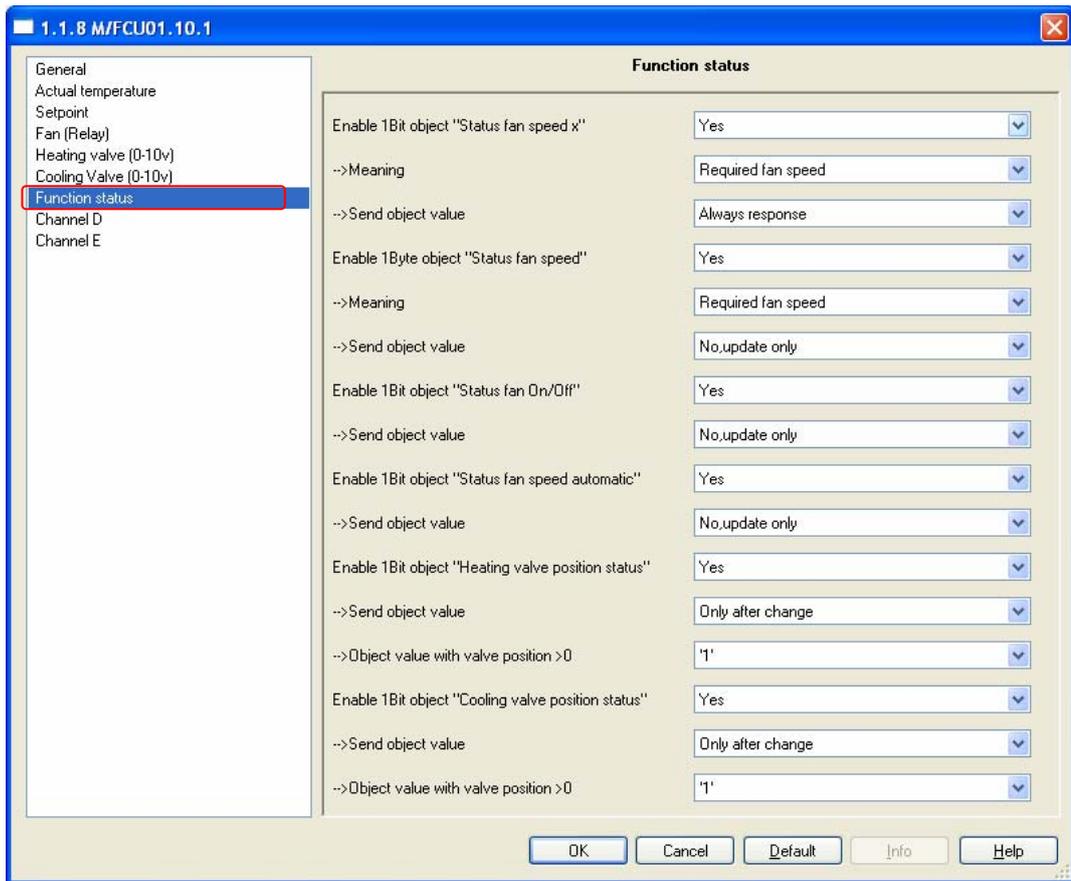


Fig.27: “Function status” parameter window

--- Enable 1Bit object “Status fan speed x” (x:1,2,3)

Options:**NO**
Yes

Set the enable of the response about the fan speed’s status.

NO: There is not response.

Yes: Three 1 bit communication objects, *Status fan speed x*, x = 1 to 3 are enabled.



Fig. 28: 1Bit fan speed status

-->Meaning

This parameter defines whether the status of the *current fan speed* or the *required fan speed* is displayed.

Options:**Current fan speed**
Required fan speed

Current fan speed: it response the fan speed is actually operating.

Required fan speed: it response the fan speed has to be achieved.

-->**Send object value**

Options:**No, update only**

Always response

Only after change

No, update only: The status byte is always updated but never sent.

Always response: The status byte is always sent regardless whether the status changes.

Only after change: Status changes are sent to the status bit on the KNX.

--- **Enable 1Byte object “Status fan speed ”**

This status byte defines the figure value of the fan speed.

Options: **NO**

Yes

Yes: The object *Status fan speed* is enabled. This status byte defines the numerical value of the fan speed. This can be the actual or target speed depending on the parameterisation.

The following value assignment is applied:

1-byte values	Hexadecimal	Binary value	Speed
0	00	00000000	0(off)
1	01	00000001	Speed 1
2	02	00000010	Speed 2
3	03	00000011	Speed 3

With the enabling of the 1-byte status display *Status fan speed*, two further parameters appear:

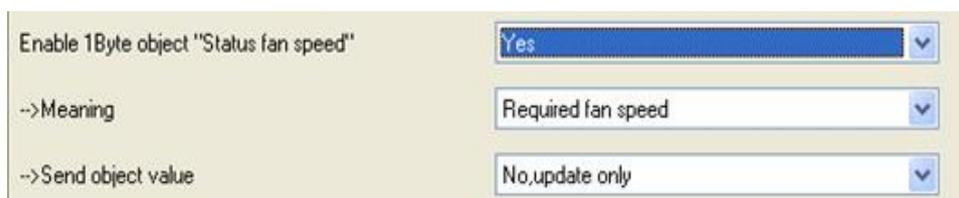


Fig. 29: 1 byte fan speed status

-->**Meaning**

This parameter defines whether the status of the *current fan speed* or the *required fan speed* is displayed.

Options:**Current fan speed**

Required fan speed

Current fan speed: it response the fan speed is actually operating.

Required fan speed: it response the fan speed has to be achieved.

-->Send object value

Options:**No, update only**
Always response
Only after change

No, update only: The status byte is always updated but never sent.

Always response: The status byte is always sent regardless whether the status changes.

Only after change: Status changes are sent to the status bit on the KNX.

--- Enable 1Bit object “Status fan On/Off”

Options: **NO**
Yes

NO: there is not response.

Yes: it response the fan speed status On or Off.

Some fans initially require an ON telegram before they are set to a fan speed from the OFF state. This ON telegram effects a main switch which has to be switched on.

This demand can be implemented with any switch output which is controlled via the *Status fan* communication object. The corresponding switch communication object of the switch actuator should be connected with the *Status fan* communication object.



Fig. 30: 1Bit fan speed ON/OFF status

-->Send object value

Options:**No, update only**
Always response
Only after change

No, update only: The status is always updated but not sent.

Always response: The status is always sent regardless whether the status changes.

Only after change: Status changes are sent to the status bit on the KNX.

--- Enable 1Bit object “Status fan speed automatic”

Options: **NO**
Yes

NO: There is not response.
Yes: It response the fan speed automatic status.



Fig. 31: 1Bit fan speed automatic status

-->Send object value
 Options:**No, update only**
 Always response
 Only after change

No, update only: The status is always updated but not sent.
Always response: The status is always sent regardless whether the status changes.
Only after change: Status changes are sent to the status bit on the KNX.

--- Enable 1Bit object “Heating valve position status”
--- Enable 1Bit object “Cooling valve position status”
 Options: **NO**
 Yes

NO: there is not response.
Yes: it response the valve position status.

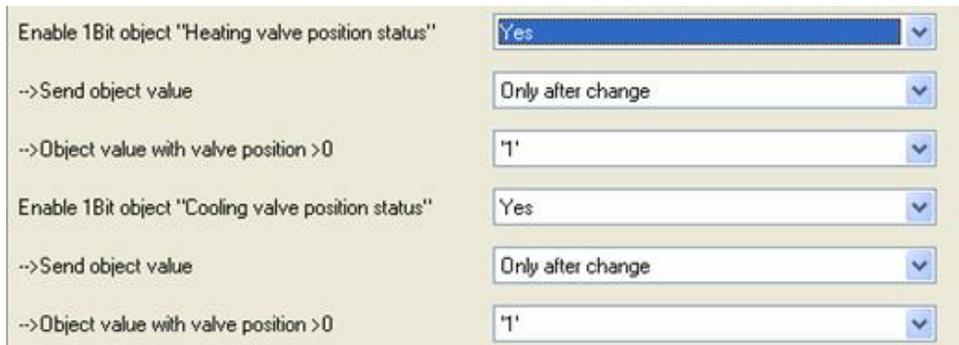


Fig. 32: Valve status

-->Send object value
 Options:**No, update only**
 Only after change

No, update only: The status is always updated but not sent.
Only after change: Status changes are sent to the status bit on the KNX.
-->Object value with valve position >0
 Options: **'0'**
 '1'

3.4 Function parameter “Floor Heating”

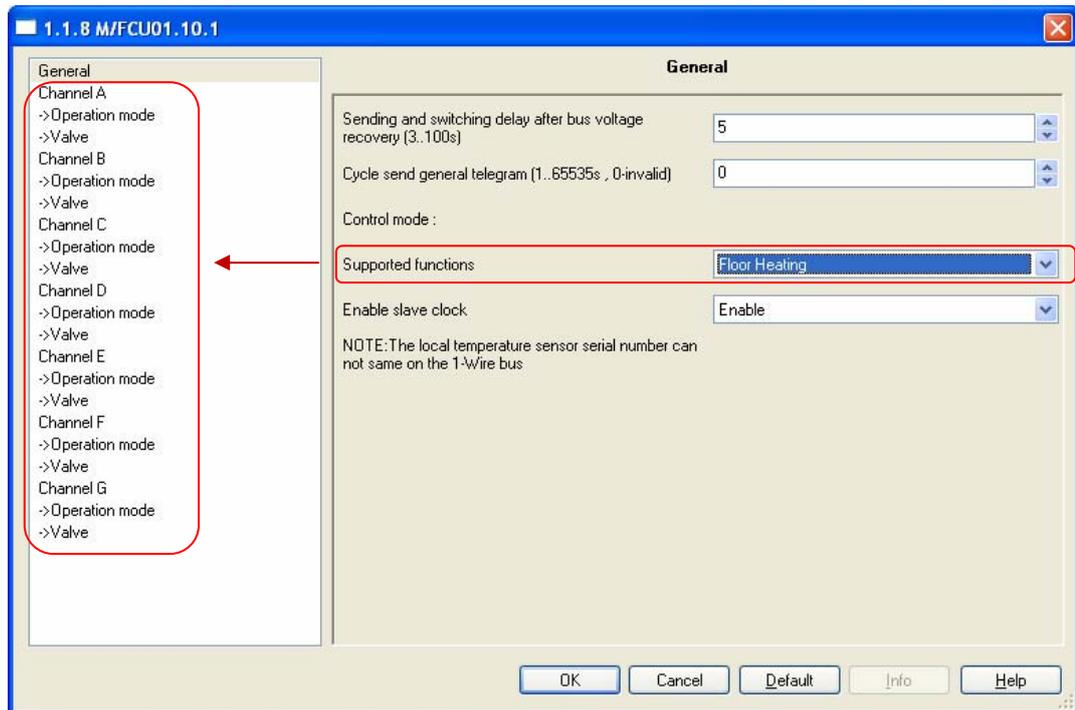


Fig.33: “Floor Heating” parameter window

Setting the functions of the floor heating. This parameter is only visible if the option “Floor Heating” has been selected for the parameter *Supported functions*. It can be configured maximum seven channels and parameterised independently. Each channels can be read the temperature via the KNX/EIB or the local temperature sensors.

---Enable slave clock

Options: **Disable**
Enable

Disable: Disable the slave clock.

Enable: Enable the slave clock, only used for timer mode. At the same time, three communication objects for activation of the slave clock are enabled. The local clock of slave system clock shall be synchronised by reception of a ‘System Clock’ information from the master system clock.

3.4.1 Channel A (Floor heating)

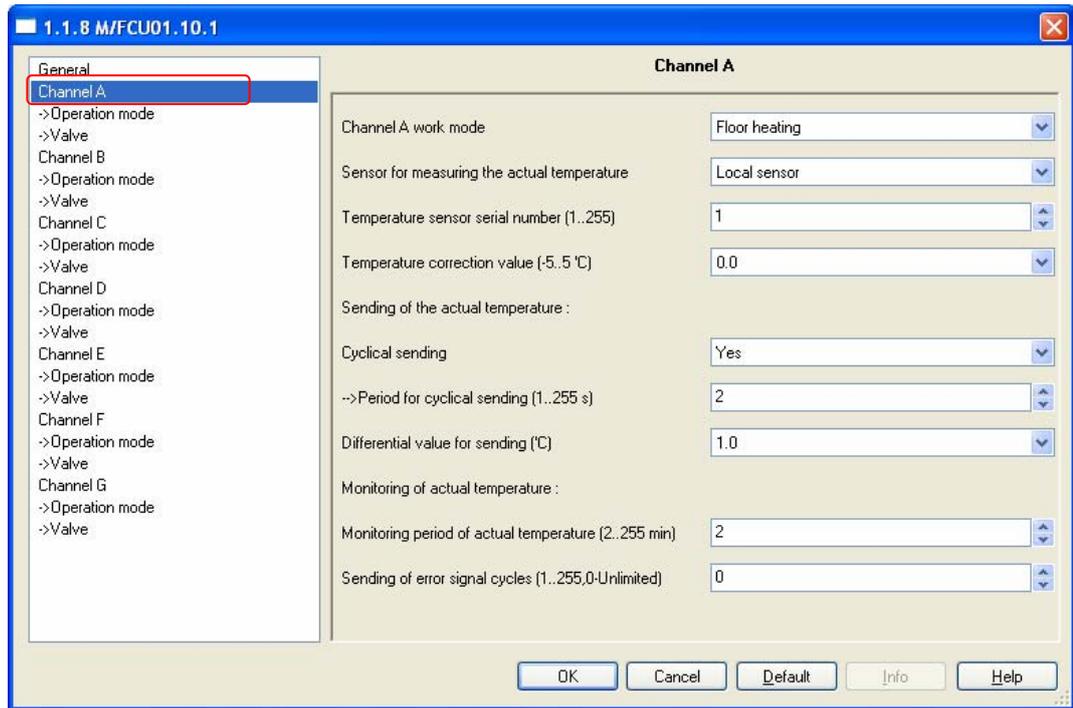


Fig.34: “Channel A” floor heating parameter window

Each channel (A,B,C,D,E) output of the Floor heating are independent and the same. So, Understand only one channel output is enough. The following paragraph will description of the first channel output in detail.

---Channel A work modeOptions:**Inactive****Floor heating****Switch controller****Inactive:** The channel inactive.**Floor heating:** The channel is used to floor heating .**Switch controller:** The channel is used to switch controller.

➤ If the channel select the floor heating , the following parameter will appears.

---Sensor for measuring the actual temperatureOptions:**Local sensor****Via EIB**

Local sensor: The temperature sensor TS/C 1.0 is must connected to the Fan Coil Unit Controller. One local temperature sensor corresponds to one channel. In this case,some parameters for local sensor become visible.

Sensor for measuring the actual temperature	Local sensor
Temperature sensor serial number (1..255)	1
Temperature correction value (-5..5 °C)	0.0
Sending of the actual temperature :	
Cyclical sending	Yes
-->Period for cyclical sending (1..255 s)	2
Differential value for sending (°C)	1.0

Fig. 35: Local sensor

Via EIB: The actual temperature is get from the other devices via KNX/EIB. One temperature sensor object corresponds to one channel. In this case, some parameters for KNX/EIB temperature sensor become visible.

Sensor for measuring the actual temperature	Via EIB
Temperature correction value (-5..5 °C)	0.0
Read temperature cyclically via EIB	Yes
-->Period for cyclical reading (1..255 s)	2

Fig. 36: Sensor via KNX/EIB

Local sensor:

--- Temperature sensor serial number (1..255)

Options: 1..255

Each temperature sensor TS/C 1.0 has a serial number. The number is the temperature sensor's address and can not same on the M/FCU01.10.1.

--- Temperature correction value(-5..5°C)

Options: -5...5

Correction of the value measured by the temperature sensor TS/C 1.0.

Sending of the actual temperature:

--- Cyclical sending

Options: **NO**

YES

NO: Don't sending the actual local temperature to the KNX /EIB bus.

YES: Sending the actual local temperature to the KNX/EIB bus.

Activation of the cyclical transmission function for the actual local temperature. This parameter is only visible if the option "Local sensor" is set for the parameter *Sensor for measuring the actual temperature*.

The following parameters are visible:

→ **Period for cyclical sending (1..255s)**

Options: 1...255s

Setting the cyclical transmission period for the actual temperature.

→ **Differential value for sending(°C)**

Options:0.5

1.0

1.5

2.0

2.5

3.0

Setting the temperature change at which the actual temperature is sent in addition to being sent after a change in value.

Via EIB:

--- **Temperature correction value(-5..5°C)**

Options: -5...5

Correction of the value measured by the actual temperature received via the KNX/EIB.

--- **Read temperature cyclically via EIB**

Options: **NO**

YES

NO: Does not read temperature via EIB.

YES: Read temperature cyclically via EIB.

Activation of the cyclical reading function for the actual temperature via KNX/EIB. This parameter is only visible if the option "Via EIB" is set for the parameter *Sensor for measuring the actual temperature*.

→ **Period for cyclical reading (1..255s)**

Options:1...255s

Setting the cyclical reading period for the actual temperature via KNX/EIB.

Monitoring of actual temperature:

--- **Monitoring period of actual temperature (2...255min)**

Options: 2...255min

Setting the monitoring period for the actual temperature (local and via the KNX).

--- Sending of error signal cycles (1..255,0-Unlimited)

Options:0..255 (0)

For setting the send repetition in the event of an error message. If the option “1..255” is selected, the error signal is only sent 1..255 counts if there is a change in the object value. If the option “0-Unlimited” is set, the object value is sent according to the parameterised *Monitoring period of actual temperature (2..255 min)*.

3.4.1.1 ->Operation mode

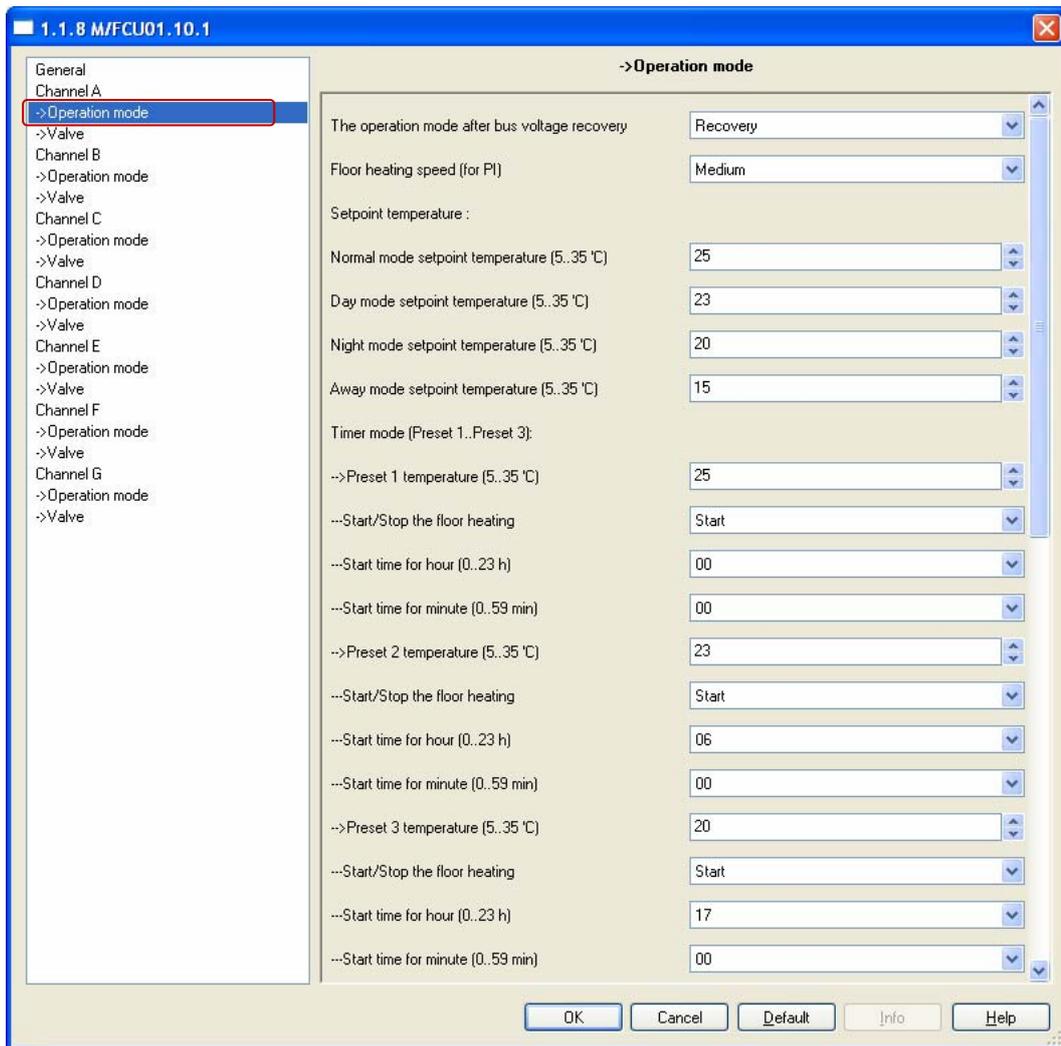


Fig.37: “Operation mode” floor heating parameter window

The parameters are the channel A’s floor heating functions.

---The operation mode after bus voltage recovery

After bus voltage recovery channel A's operation modes.

Options: **Recovery**
 Normal
 Day
 Night
 Away
 Timer

Recovery: After bus voltage recovery the mode which existed before bus voltage failure is set.

Normal, Day, Night, Away, Time: Each operation mode has different setpoint temperature, you can select the operation mode with the actual situation.

--- Floor heating speed (for PI)

if you have sufficient knowledge in heating technology so that the appropriate settings are carried out correctly. The options are suitable for standard applications.

Options: **Lower**
 Low
 Medium
 Fast
 Faster

Setting the PI controller response for heating. There is 5 speeds for the heating.

Setpoint temperature:

--- Normal mode setpoint temperature(5..35°C)

--- Day mode setpoint temperature(5..35°C)

--- Night mode setpoint temperature(5..35°C)

--- Away mode setpoint temperature(5..35°C)

Options: **5..35**

Setting the floor heating's setpoint temperature. Each operation mode has different setpoint temperature. When you want to change the room temperature only need a simple change operating mode can change to the corresponding temperature.

Timer mode (Preset 1...Preset 3):

Settint the floor heating's timer mode preset (Preset 1, Preset 2, Preset 3). Each timer mode preset set a different temperature and different start time. When the slave clock running to any of the preset time, it is working to the corresponding preset mode.

Timer mode (Preset 1..Preset 3):	
-->Preset 1 temperature (5..35 °C)	25
--Start/Stop the floor heating	Start
--Start time for hour (0..23 h)	00
--Start time for minute (0..59 min)	00
-->Preset 2 temperature (5..35 °C)	23
--Start/Stop the floor heating	Start
--Start time for hour (0..23 h)	06
--Start time for minute (0..59 min)	00
-->Preset 3 temperature (5..35 °C)	20
--Start/Stop the floor heating	Start
--Start time for hour (0..23 h)	17
--Start time for minute (0..59 min)	00

Fig. 38: Timer mode

Preset 2 and preset 3's settings are same as preset 1.

→ **Preset 1 temperature (5..35°C)**

→ **Preset 2 temperature (5..35°C)**

→ **Preset 3 temperature (5..35°C)**

Options: **5..35**

24 hours a day is divided into three preset time corresponding three temperature point, so it in different period of time can automatic switching to different temperature.

→ **Start/Stop the floor heating**

Options: **Stop**

Start

Start or stop the floor heating in current slave clock.

→ **Start time of hour (0..23h)**

Options: **0..23**

Setting the start time of hour for the preset 1(2,3).

→ Start time of minute (0..59min)

Options: **0..59**

Setting the start time of minute for the preset 1(2,3).

3.4.1.2 ->Valve

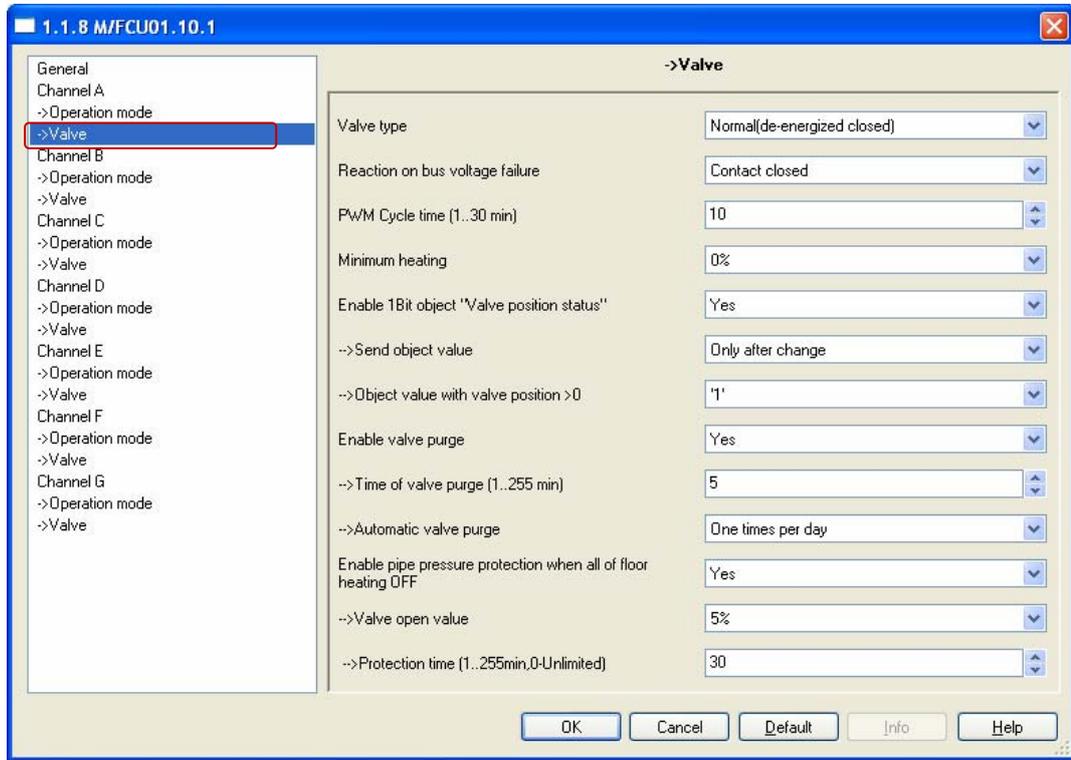


Fig.39: "Valve" floor heating parameter window

--- Valve type

Options: **Inverted(de-energized opened)**
Normal(de-energized closed)

Setting the control direction of the valve.

--- Reaction on bus voltage failure

Setting the valve position after the bus voltage failure.

Options: **Contact unchanged**
Contact open
Contact closed

Contact unchanged: The valve remains unchanged at bus voltage failure.

Contact open: The valve remains opened at bus voltage failure.

Contact closed: The valve remains closed at bus voltage failure.

--- PWM Cycle time (1..30min)

This is used to set the cycle time of the PWM control.

Options: **1..30min**

An actuation cycle consists of one on and one off process and forms a PWM period. Example: Actuating value= 20%, PWM time = 10 min: In an actuating cycle of 10 min, 2 min switched on and 8 min switched off (i.e. 20% on/ 80% off).

--- Minimum heating

Options: **0%, 5%, 10%, 15%, 20%**

Minimum permissible valve setting with actuating value.

--- Enable 1Bit object Valve position status

Options: **NO**

Yes

NO: there is not response.

Yes: it response the valve position status.

If you select yes , The following parameters appear:

→ **Send object value**

Options: **No, update only**

Only after change

No, update only: The status is always updated but not sent.

Only after change: Status changes are sent to the status bit on the KNX.

→ **Object value with valve position>0**

Options: **'0'**

'1'

--- Enable valve purge

Options: **NO**

Yes

NO: Disable valve purge.

YES: The 1 bit *Trigger valve purge* communication object is enabled.

With this parameter, the function of a valve purge of the output can be enabled. Regular purging of a heating valve can prevent deposits from forming in the valve area and restricting the valve function. At the same time it is assured that the heating element is purged which simplifies the bleeding of trapped air. This is particularly important at times when the valve position does not change very much. The valve is opened to the maximum during a valve purge. It can be triggered via the object *Trigger valve purge* and/or

automatically at adjustable intervals. With the option **YES**, the objects *Trigger valve purge* and *Status valve purge* are enabled. Also the parameter *Time of valve purge in minutes (1...255)* and *Automatic valve purge* are enabled.



Enable valve purge	Yes
-->Time of valve purge (1..255 min)	5
-->Automatic valve purge	One times per day

Fig. 40: Valve purge

→Time of valve purge(1..255min)

Options: **1..255min**

Set the time for the valve purge. In this time the valve is fully opened. When the time has elapsed, the state before the purge is re-established.

→Automatic valve purge

Set the automatic valve purge frequency.

Options:**NO**

One times per day

One times per week

One times per month

One times per day: Automatic valve purge every day.

One times per week: Automatic valve purge every week.

One times per month: Automatic valve purge every month.

A purge can be initiated by the object *Trigger valve purge*. The counter for automatic purging starts to run when the parameter is loaded in the actuator. The time is reset each time it is downloaded. The time is reset as soon as purging is completed. This can occur either through automatic purging or via the object *Trigger valve purge*.

--- Enable pipe pressure protection when all of floor heating OFFOptions: **NO****Yes****NO:** Disable this channel pipe pressure protection.**YES:** Enable this channel pipe pressure protection when all of room floor heating turn off.

When all of room floor heating turn off, pipe pressure will increase, easy to cause the damage, so must carry on the timing of the reduced pressure, this process in order to prevent a room temperature is too high, and each channel can timing take turns exhaust pressure work. At the same time only one channel will be open. When one of the room floor heating is turn on, all of the pipe pressure protection will end.

→ Valve open valueOptions: **5%****10%****15%****20%****25%****30%**

Setting the valve's position open value.

→ Protection time(1..255min,0-Unlimited)Options: **0-Unlimited****1..255min**

A channel to protect time, when time end turn to the next channel reduced pressure protection. If the option "1..255 min" is selected, the channel is only working 1..255 min then turn to the next channel. If the option "0-Unlimited" is set, the channel is working all the time until one of the room turn on the floor heating.

The floor heating parameter windows “Channel A,B,C,D,E,F,G” , “Operation mode” and “Valve” with the parameter of control functions are largely similar. Only the following functions channel F,G’s valve differ from channel A,B,C,D,E’s valve.

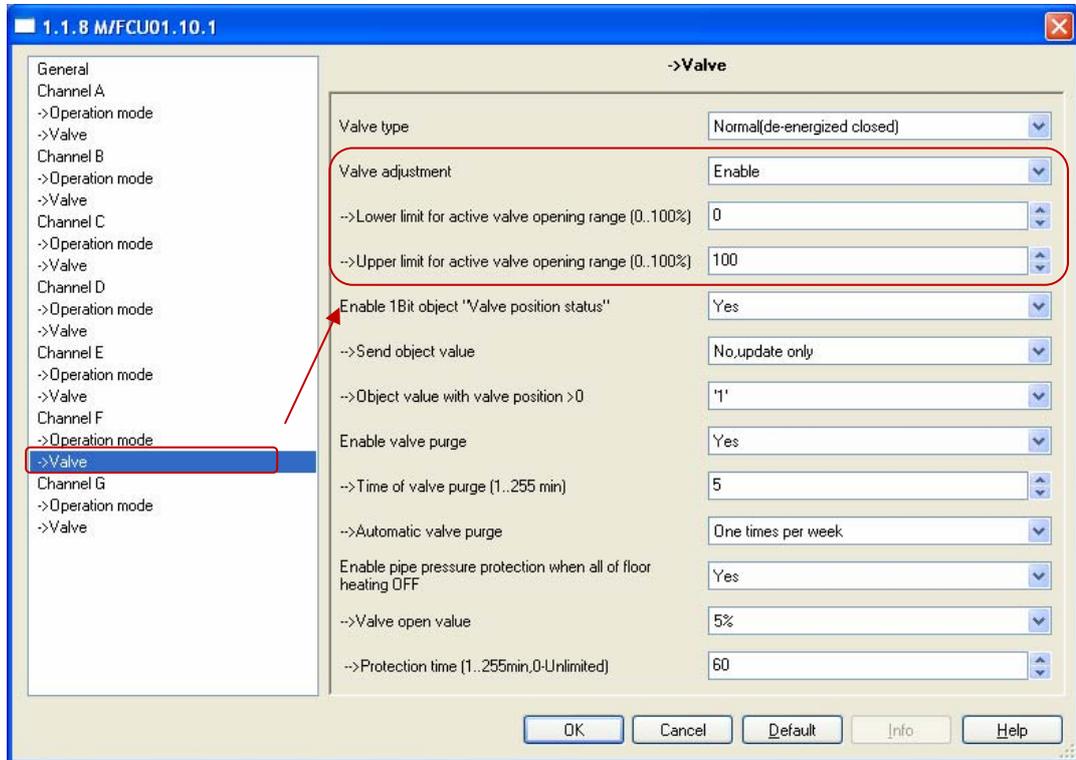


Fig.41: “Valve” floor heating channel F,G parameter window

---Valve adjustment

User-defined adjustment of the valve characteristics.

Options:**Disable**
Enable

Disable: Disable the valve adjustment.

Enable: Enable the valve adjustment.

Only select the option “Enable” if you have sufficient knowledge in heating technology so that the appropriate settings are carried out correctly. The option “Disable” is suitable for standard applications.

→Lower limit for active valve opening range (0..100%)

→Upper limit for active valve opening range (0..100%)

Options: **0..100%**

For setting the valve characteristic curve i.e. the valve position dependent on the control value.

3.5 Function parameter “Switch actuator”

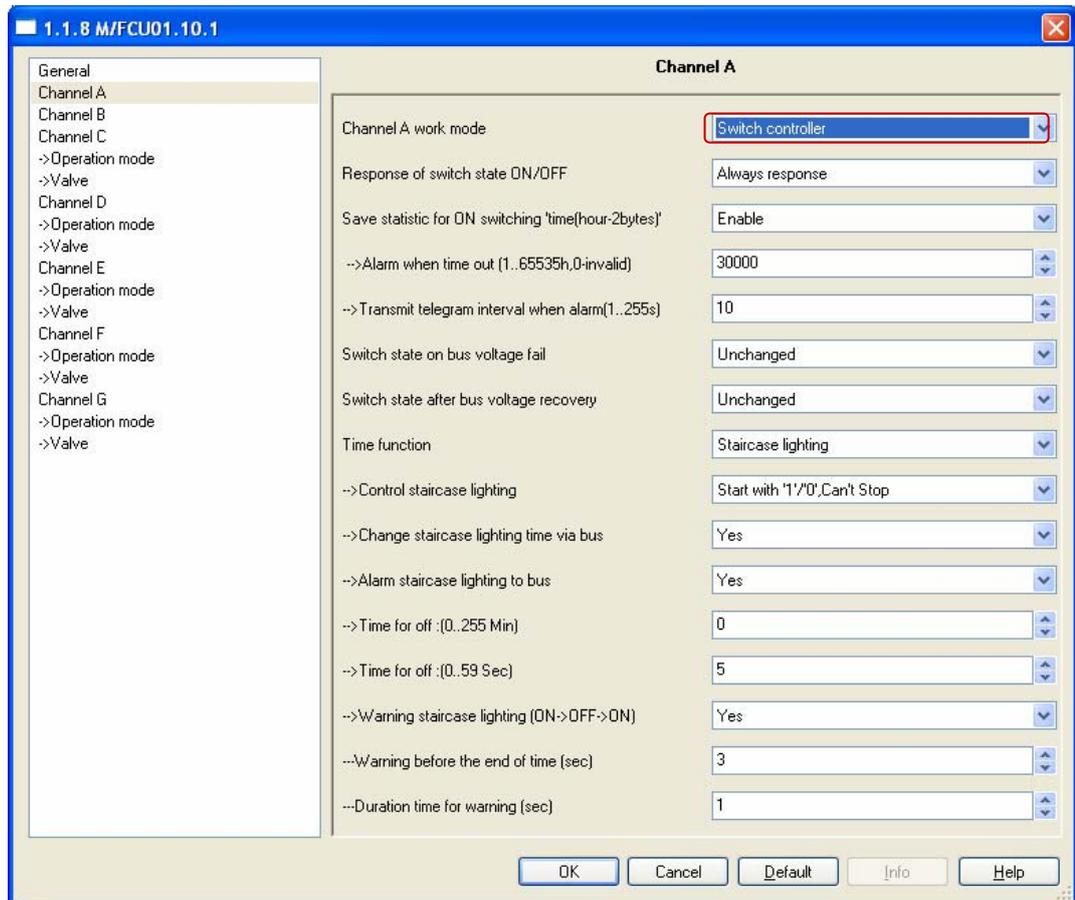


Fig.42: “Channel A work mode of switch controller” parameter window

Each relay channel (A,B,C,D,E) whether in HVAC or floor heating function, no use channel can be configured to switch controller. It can used to control light or other switch products.

More functions setup in this mode, the following section will description detailed of the Switch Actuator mode.

--- Response if switch state ON/OFF

This parameter determine the work mode of response

Options:**No response**

Always response

Only after change

No response: No response switch state.

Always response: Always response switching state when receive the channel telegram data.

Only after change: Only response switch state of the channel when change state changed.

--- Save statistic for ON switching “time (hour-2bytes)”

This function is used to calculate the total ON time for channel output, The maximum time is 65535h. This function is very useful, Because can know channel work status through this function.

Options: **Disable**
Enable

Disable: Disable Statistics ON time.

Enable: Enable Statistics ON time.

→Alarm when time out(1...65535,0-invalid)

This parameter set the ON time alarm overflow time.

Options: **1..65535h, 0-invalid**

When the device's operating time arrive the setting value will alarm. The value rang is 1...65535h, 0 is invalid.

→Transmit telegram interval when alarm(1...65535,0-invalid)

Options: **1..65535, 0-invalid**

Set the alarm time interval.

--- Switch state on bus voltage fail

When bus voltage failure and the function will be executed. Three choices will be available as following:

Options: **Unchange**
ON
OFF

Unchange: The channel switch position unchanged after bus voltage failure

ON: The channel position will be switch ON after bus voltage failure

OFF: The channel position switch OFF after bus voltage failure

--- Switch state after bus voltage recovery

When power on and the bus voltage recovery, This function will be executed. four selection will be available as following:

Options: **Unchanged**
Recovery
ON
OFF

Unchange: The channel switch position unchanged after bus voltage recovery.

Recovery: After bus voltage recovery, The channel switch position will be back to the state of the power-down previous.

ON: The channel position will switch ON after bus voltage recovery.

OFF: The channel position will switch OFF after bus voltage recovery.

--- Time function

Options: **Disable**

Staircase lighting

ON/OFF delay

Disable: disable time function.

Staircase lighting: Control staircase light.

ON/OFF delay: This function is including switch ON delay and switch OFF delay.

Staircase lighting:

Time function	Staircase lighting
-->Control staircase lighting	Start with '1/0',Can't Stop
-->Change staircase lighting time via bus	Yes
-->Alarm staircase lighting to bus	Yes
-->Time for off :(0..255 Min)	0
-->Time for off :(0..59 Sec)	5
-->Warning staircase lighting (ON->OFF->ON)	Yes
--Warning before the end of time (sec)	3
--Duration time for warning (sec)	1

Fig.43: Staircase lighting

--- Control staircase lighting

Options: **Start with “1”, Stop with“0”**

Start with“1”, Invalid with“0”

Start with“1/0”,Can’t stop

Start with “1”, stop with“0”: When receive data 1 and the staircase light start run automatic, stop with time out or stop with 0.

Start with“1”, invalid with“0”: When receive data 1 and the staircase light start run automatic, 0 is invalid.

Start with“1/0”, can’t stop: When receive data 1/0 and the staircase light start run automatic, Can’t stop.

--- Change staircase lighting time via bus

Options:**NO**
YES

NO: Can't modify staircase lighting delay off time via bus , only can be set by database.

YES: Allow modify staircase lighting delay off time via bus by user.

--- Alarm staircase lighting to bus

Options:**NO**
YES

NO: Prohibition alarm.

YES: Allow send out warning state use alarm data point for ON/OFF staircase light.

--- Time for off : (0..255 Min)

Options:**0..255 Min**

Duration minutes of the staircase lighting delay off time.

--- Time for off : (0..59 Sec)

Options:**0..255 min**

Duration seconds of the staircase lighting delay off time.

--- Warning staircase lighting (ON→OFF→ON)

Options:**NO**
YES

NO: Not allow alarm

YES: Allow alarm.

→ Warning before the end of time (sec)


Options:**3..100 sec**

Note: If this time out range of the total staircase light time,then the warning function is invalid.

→ Duration time for warning (sec)

Options:**1..10 sec**

Note: If this time out range of the total staircase light time,then the warning function is invalid.

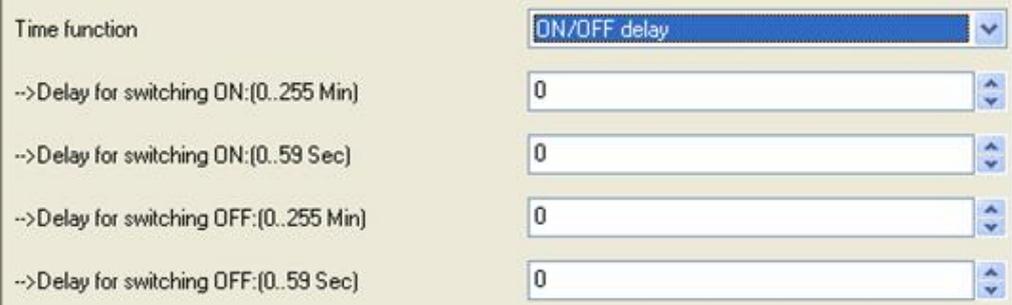ON/OFF delay:

Time function	ON/OFF delay
-->Delay for switching ON:(0..255 Min)	0
-->Delay for switching ON:(0..59 Sec)	0
-->Delay for switching OFF:(0..255 Min)	0
-->Delay for switching OFF:(0..59 Sec)	0

Fig.44: ON/OFF delay

This function is including switch ON delay and switch OFF delay.

--- Delay for switching ON : (0..255 Min)

Options:0..255 Min

Duration minutes of the ON delay.

--- Delay for switching ON : (0..59 Sec)

Options:0.. 59 Sec

Duration seconds of the ON delay.

--- Delay for switching OFF : (0..255 Min)

Options:0..255 Min

Duration minutes of the OFF delay.

--- Delay for switching OFF : (0..59 Sec)

Options:0.. 59 Sec

Duration seconds of the OFF delay.

4-Communication objects description

In this section will introduce the communication objects, The objects will show by setting the function enable. In the Fan/Fan coil controller: **fan**, **Heating** or **Cooling** communication objects are the same with **Heating and cooling**. So, the following paragraph will description of the **Heating and cooling** and **Floor heating** communication objects in detail.

4.1 Objects “General”

Number	Name	Object Function	Description	Gro...	Length	C	R	W	T	U	D..	Priority
0	General	Send cycles			1 bit	C	R	-	T	-		Low

NO.	Object name	Function	Flags	Data type
0	General	Send cycles	C R T	DPT 1.003 1bit

This communication object is always active and valid. invert the value send telegram to bus in next frame. e.g. last telegram value is “1”, the next telegram value is “0”

4.2 Fan/Fan coil controller

4.2.1 Objects “Actual temperature”

10	Actual temperature	Actual temperature 1		2 Byte	C	R	W	T	U		Low
11	Actual temperature	Actual temperature 2		2 Byte	C	R	W	T	U		Low
12	Actual temperature	Actual temp. 1 error signal		1 bit	C	R	-	T	-		Low
13	Actual temperature	Actual temp. 2 error signal		1 bit	C	R	-	T	-		Low
14	Actual temperature	Frost/heat alarm error signal		1 bit	C	R	-	T	-		Low

NO.	Object name	Function	Flags	Data type
10	Actual temperature	Actual temperature 1	C R W T U	DPT 9.001 2 byte

If the Fan Coil Unit Controller is operated with the temperature sensor TS/C 1.0 connected, the actual temperature is sent to this communication object via the KNX/EIB. Cyclical sending can also be set in the parameters. The parameterized *Temperature 1 Correction value* is included.

If the Fan Coil Unit Controller is operated without the temperature sensor, it receives the actual temperature via the KNX/EIB at this communication object.

11	Actual temperature	Actual temperature 2	C R W T U	DPT 9.001 2 byte
----	--------------------	----------------------	-----------	---------------------

This object is only visible if the option “Two sensor via EIB (Count=2)” is selected, it receives the actual temperature via the KNX/EIB at this communication object.

12	Actual temperature	Actual temp. 1 error signal	C R T	DPT 1.005 1bit
----	--------------------	-----------------------------	-------	-------------------

An error signal can be sent to the KNX/EIB with this object if the space temperature 1 has not been refreshed within a set period. The output of the error signal can occur 1..255 or cyclically.

Telegram value: "0": No error "1": Error				
13	Actual temperature	Actual temp. 2 error signal	C R T	DPT 1.005 1bit
An error signal can be sent to the KNX/EIB with this object if the space temperature 2 has not been refreshed within a set period. The output of the error signal can occur 1..255 or cyclically. Telegram value: "0": No error "1": Error				
14	Actual temperature	Frost/heat alarm error signal	C R T	DPT 1.005 1bit
The Fan Coil Controller sends information via this communication object about whether frost protection mode is active. Telegram value: "0": No frost/heat protection "1": Frost/heat protection				

4.2.2 Objects "Setpoint"

20	Setpoint	Base setpoint temperature	2 Byte	C R W T U	Low
21	Setpoint	Instantaneous setpoint temp.	2 Byte	C R - T -	Low
NO.	Object name	Function	Flags	Data type	
20	Setpoint	Base setpoint temperature	C R W T U	DPT 9.001 2 byte	
The base setpoint value can be modified via this input. It is stored in non-volatile memory.					
21	Setpoint	Instantaneous setpoint temp.	C R T	DPT 9.001 2 byte	
The current setpoint (base setpoint including the reduction/increase in standby mode or during night mode) can be read out from this communication object.					

4.2.3 Objects "HVAC control mode"

25	HVAC control mode	HVAC control mode (byte)	1 Byte	C R W T U	Low
26	HVAC control mode	Automatic heating/cooling mode	1 bit	C R W T U	Low
27	HVAC control mode	Activation of heating mode	1 bit	C R W T U	Low
28	HVAC control mode	Activation of cooling mode	1 bit	C R W T U	Low
29	HVAC control mode	Activation of fan only	1 bit	C R W T U	Low
NO.	Object name	Function	Flags	Data type	
25	HVAC control mode	HVAC control mode (byte)	C R W T U	DPT 20.105 1 byte	
HVAC control mode conversion. Only the following telegram value is effective. Telegram value: "0": Auto "1": Heat "3": Cool "6": Off "9": Fan only					

26	HVAC control mode	Automatic heating/cooling mode	C R W T U	DPT 1.003 1 bit
<p>These communication objects are only visible if the option “4-pipe system” is set in the parameter <i>HVAC-System</i>. According to the actual temperature heating mode and cooling mode will automatically switching. Telegram value: “0”: No function “1”: Automatic heating/cooling mode</p>				
27	HVAC control mode	Activation of heating mode	C R W T U	DPT 1.003 1 bit
<p>Heating mode is activated via these communication objects. Telegram value: “0”: No function “1”: Heating mode</p>				
28	HVAC control mode	Activation of cooling mode	C R W T U	DPT 1.003 1 bit
<p>Cooling mode is activated via these communication objects. Telegram value: “0”: No function “1”: Cooling mode</p>				
29	HVAC control mode	Activation of fan only	C R W T U	DPT 1.003 1 bit
<p>Fan only mode is activated via these communication objects. Telegram value: “0”: No function “1”: Fan only mode</p>				

Note: If a “1” is received at above communication objects, the final value received is definitive.

4.2.4 Objects “HVAC mode”

30	HVAC mode	HVAC mode (byte)	1 Byte	C R W T U	Low
31	HVAC mode	ON CMD for comfort mode	1 bit	C R W T U	Low
32	HVAC mode	ON CMD for standby mode	1 bit	C R W T U	Low
33	HVAC mode	ON CMD for night mode	1 bit	C R W T U	Low
34	HVAC mode	ON CMD for building protection	1 bit	C R W T U	Low

NO.	Object name	Function	Flags	Data type
30	HVAC mode	HVAC mode (byte)	C R W T U	DPT 20.102 1 byte
<p>Input object shall be used to the HVAC Mode. Telegram value: “1”: Comfort mode “2”: Standby mode “3”: Night mode “4”: building protection</p>				
31	HVAC mode	ON CMD for comfort mode	C R W T U	DPT 1.001 1 bit
<p>The Fan Coil Controller is switched to comfort mode via this communication object. If the device has been switched from comfort mode to night mode, the comfort extension is activated for the duration of the parameterized <i>Extended comfort mode</i></p>				

<p><i>time</i> by a telegram at this communication object. The comfort extension is restarted by each subsequent telegram. Telegram value: “0”: No function “1”: Comfort mode/comfort extension</p>				
32	HVAC mode	ON CMD for standby mode	C R W T U	DPT 1. 001 1 bit
<p>Input object for switching to standby mode. Telegram value: “0”: No function “1”: Standby mode</p>				
33	HVAC mode	ON CMD for night mode	C R W T U	DPT 1. 001 1 bit
<p>Input object for switching to night mode. Telegram value: “0”: No function “1”: Night mode</p>				
34	HVAC mode	ON CMD for building protection	C R W T U	DPT 1. 001 1 bit
<p>Input object for switching to building protection mode. Telegram value: “0”: No function “1”: building protection mode</p>				

Note: If a “1” is received at above communication objects, the final value received is definitive.

4.2.5 Objects “Fan”

40	Fan	Fan speed automatic	1 bit	C - W - U	Low
41	Fan	Fan speed with % value	1 Byte	C - W - U	Low
42	Fan	Fan speed 1	1 bit	C - W - U	Low
43	Fan	Fan speed 2	1 bit	C - W - U	Low
44	Fan	Fan speed 3	1 bit	C - W - U	Low

NO.	Object name	Function	Flags	Data type
40	Fan	Fan speed automatic	C W U	DPT 1.003 1 bit
<p>If fan speed automatic mode is activated, it will be activated on this communication object with the value ‘1’ after a download, bus reset or via a telegram. Automatic mode is switched off, if a signal is received on this communication object with the value ‘0’ , a <i>Fan speed with % value</i> or <i>Fan speed 1(2,3)</i> communication object. Fan speed limitation only used for fan speed automatic mode.</p>				
41	Fan	Fan speed with % value	C W U	DPT 5.001 1 byte
<p>With the coding below combinations of devices with different number of steps is possible. The stop of the actuator is defined and the highest speed of the controller always results in highest speed of the actuator. Steps in between are interpreted to the best. Fan speed automatic mode becomes inactive.</p>				

1-Speed				
Speed	Percent(%)	Value		
0	0	0		
I	1 - 100	1 - 255		

2-Speed		
Speed	Percent(%)	Value
0	0	0
I	1 - 50	1 - 128
II	51 - 100	129 - 255

3-Speed		
Speed	Percent(%)	Value
0	0	0
I	1 - 33	1 - 85
II	34 - 67	86 - 170
III	68 - 100	171 - 255

42	Fan	Fan speed 1	C W U	DPT 1. 001 1 bit
43	Fan	Fan speed 2	C W U	DPT 1. 001 1 bit
44	Fan	Fan speed 3	C W U	DPT 1. 001 1 bit

Via the 1 bit communication object the Fan Coil Actuator can receive a control value for fan speed x (x=1,2,3). Automatic operation is disabled. A renewed activation occurs via the communication objects *Fan speed automatic*.

If several ON commands '1' are received by the various fan speed objects, the value that was last received for the fan control is decisive. This also applies for the OFF command '0'. If the actuator for a speed that has been switched off receives another OFF command, it is carried out, i.e. a speed that is currently switched on is switched off, even though the corresponding fan speed object does not act directly on the speed. The last command – in this case the OFF command of another speed – is always executed.

Telegram value: "0": Fan OFF
 "1": Fan speed x ON

4.2.6 Objects “Fan status”

45	Fan	Status fan speed 1	1 bit	C R - T -	Low
46	Fan	Status fan speed 2	1 bit	C R - T -	Low
47	Fan	Status fan speed 3	1 bit	C R - T -	Low
48	Fan	Status fan speed	1 Byte	C R - T -	Low
49	Fan	Status fan On/Off	1 bit	C R - T -	Low
50	Fan	Status fan speed automatic	1 bit	C R - T -	Low

NO.	Object name	Function	Flags	Data type
45	Fan	Status fan speed 1	C R T	DPT 1.001 1 bit
46	Fan	Status fan speed 2	C R T	DPT 1.001 1 bit
47	Fan	Status fan speed 3	C R T	DPT 1. 001 1 bit

These objects are enabled if the parameter *Enable 1bit object “Status fan speed x”* is enabled in the parameter window *Function status*. It can be parameterised (see parameter window *Function status*) whether the object value is only updated, always sent on the KNX/EIB or only sent after a change. It can be parameterised for the status to indicate a current fan speed or a required fan speed.

With this object, is possible to display the fan speed in a visualisation program or to indicate it using a diode.

Telegram value: ‘0’ = fan speed OFF
 ‘1’ = fan speed ON

48	Fan	Status fan speed	C R T	DPT 5. 010 1 byte
----	-----	------------------	-------	----------------------

This object is enabled if the parameter *Enable 1-byte object “Status fan speed”* is enabled in the parameter window *Function status*. It can be parameterised (see parameter window *Function status*) whether the object value is only updated, always sent on the KNX/EIB or only sent after a change. It is possible to parameterise if the actual or required speed are displayed with the status object. With this object it is possible for example to display the fan speed on the display as a direct numerical value.

The following telegram values apply for the 1-byte object:

Numerical value	Hexadecimal	Binary value	Speed
0	00	00000000	0 (off)
1	01	00000001	Speed 1
2	02	00000010	Speed 2
3	03	00000011	Speed 3

49	Fan	Status fan On/Off	C R T	DPT 1. 001 1 bit
----	-----	-------------------	-------	---------------------

This object is enabled if the parameter *Enable 1Bit object “Status fan On/Off”* is enabled in the parameter window *Function status*. It is possible to parameterise if an object value is only updated, always sent on the KNX/EIB or only sent after a change.

Telegram value: '0' = fan speed OFF '1' = fan speed ON				
50	Fan	Status fan speed automatic	C R T	DPT 1. 003 1 bit
<p>This object is enabled if the parameter <i>Enable 1Bit object "Status fan speed automatic"</i> is enabled in the parameter window <i>Function status</i>. It is possible to parameterise if an object value is only updated, always sent on the KNX/EIB or only sent after a change. The object indicates the status of the fan speed automatic mode.</p> <p>Telegram value: '0' = inactive '1' = activated</p>				

4.2.7 Objects “Fan limitation”

51	Fan	Limitation 1	1 bit	C R W T U	Low
52	Fan	Limitation 2	1 bit	C R W T U	Low
53	Fan	Limitation 3	1 bit	C R W T U	Low
54	Fan	Limitation 4	1 bit	C R W T U	Low

NO.	Object name	Function	Flags	Data type
51	Fan	Limitation 1	C R W T U	DPT 1.003 1 bit
52	Fan	Limitation 2	C R W T U	DPT 1. 003 1 bit
53	Fan	Limitation 3	C R W T U	DPT 1. 003 1 bit
54	Fan	Limitation 4	C R W T U	DPT 1. 003 1 bit

These objects are enabled if the parameter *Enable limitations (Automatic fan control)* is enabled in the parameter window *Fan (Relay)* or *Fan (0-10v)*. The limitation x (x=1,2,3,4) is active if a telegram with the value '1' is received on the communication object *Limitation x*. All the *Limitation x* is deactivated if a telegram with the value '0' is received on the communication object *Limitation x*.

When *Limitation x* is activated, the fan can only assume the set fan speed or fan speed range in the parameter window *Fan (Relay)* or *Fan (0-10v)*. The valve position is independently programmable from the fan limitation.

If several *Enable* commands '1' are received by the various limitation objects, the value that was last received for the fan speed limitation control is decisive. This also applies for the *Disable* command '0'. If the fan speed for a limitation function that has been inactive receives another *Disable* command, it is carried out, i.e. a limitation function that is currently is inactive, even though the corresponding limitation function object does not act directly on the limitation object. The last command – in this case the *Disable* command of another limitation object– is always executed.

Telegram value: '0' = All limitation disable
'1' = limitation x enable

If the value '1' is set in the parameter "Object value with valve position>0": Telegram value: '0' = Valve position equal to zero '1' = Valve position not equal to zero If the value '0' is set in the parameter "Object value with valve position>0": Telegram value: '0' = Valve position not equal to zero '1' = Valve position equal to zero				
64	Valve Cooling	Trigger valve purge	C W U	DPT 1. 017 1 bit
The cooling valve purge is triggered using this communication object. The purge cycle with automatic purge will be restarted. Telegram value: '0' = end valve purge, valve will be closed '1' = start valve purge, valve will be opened				
65	Valve Cooling	Status valve purge	C R T	DPT 1. 003 1 bit
The status of the cooling valve purge is visible via this communication object. Telegram value: '0' = valve purge not active '1' = valve purge active				

4.3 Floor heating

4.3.1 Objects "Slave clock"

The local clock of slave system clock shall be synchronised by reception of a 'System Clock' information from the master system clock.

1	Slave clock	Network datetime	8 Byte	C - W T U	Low
2	Slave clock	Network date	3 Byte	C - W T U	Low
3	Slave clock	Network time of day	3 Byte	C - W T U	Low

NO.	Object name	Function	Flags	Data type
1	Slave clock	Network datetime	C W T U	DPT 19.001 8 byte
Input time & date information synchronisation of clocks in the system				
2	Slave clock	Network date	C W T U	DPT 11.001 3 byte
Input for date synchronisation of clocks in the system.				
3	Slave clock	Network time of day	C W T U	DPT 10.001 3 byte
Input for time synchronisation of clocks in the system.				

4.3.2 Objects “Pipe pressure protection”

4 Floor heating Pipe pressure protection 1 bit C R - T - Low

NO.	Object name	Function	Flags	Data type
4	Floor heating	Pipe pressure protection	C R T	DPT 1.001 1 blt
This communication object is used for pipe pressure protection. If all of the floor heating channel are turn off, this object status is sent ON,then the response status value is “1”, Otherwise the status value is “0”				

4.3.3 Objects “Floor heating N”

In this section will introduce the floor heating N communication objects, The objects will show by setting the floor heating N function enable .

Note: In following sections the N=A,B,C,D,E,F,G

5	Floor heating A	Actual temperature	2 Byte	C R W T U	Low
6	Floor heating A	Actual temp. error signal	1 bit	C R - T -	Low
7	Floor heating A	Normal-mode setpoint Temp.	2 Byte	C R W T U	Low
8	Floor heating A	Day-mode setpoint Temp.	2 Byte	C R W T U	Low
9	Floor heating A	Night-mode setpoint Temp.	2 Byte	C R W T U	Low
10	Floor heating A	Away-mode setpoint Temp.	2 Byte	C R W T U	Low
11	Floor heating A	Preset 1 Temp. for timer mode	2 Byte	C R W T U	Low
12	Floor heating A	Time of day for preset 1	3 Byte	C R W T U	Low
13	Floor heating A	Start/Stop heating for preset1	1 bit	C R W T U	Low
14	Floor heating A	Preset 2 Temp. for timer mode	2 Byte	C R W T U	Low
15	Floor heating A	Time of day for preset 2	3 Byte	C R W T U	Low
16	Floor heating A	Start/Stop heating for preset2	1 bit	C R W T U	Low
17	Floor heating A	Preset 3 Temp. for timer mode	2 Byte	C R W T U	Low
18	Floor heating A	Time of day for preset 3	3 Byte	C R W T U	Low
19	Floor heating A	Start/Stop heating for preset3	1 bit	C R W T U	Low
20	Floor heating A	Floor heating(1-ON,0-OFF)	1 bit	C R W T U	Low
21	Floor heating A	ON CMD for Normal-mode	1 bit	C R W T U	Low
22	Floor heating A	ON CMD for Day-mode	1 bit	C R W T U	Low
23	Floor heating A	ON CMD for Night-mode	1 bit	C R W T U	Low
24	Floor heating A	ON CMD for Away-mode	1 bit	C R W T U	Low
25	Floor heating A	ON CMD for Timer-mode	1 bit	C R W T U	Low
26	Floor heating A	Status valve position	1 bit	C R - T -	Low
27	Floor heating A	Trigger valve purge	1 bit	C - W - U	Low
28	Floor heating A	Status valve purge	1 bit	C R - T -	Low
29	Floor heating A	Instantaneous setpoint temp.	2 Byte	C R - T -	Low

NO.	Object name	Function	Flags	Data type
5, 30...	Floor heating N	Actual temperature	C R W T U	DPT 9.001 2 byte
If the Floor heating N is operated with the temperature sensor TS/C 1.0 connected, the actual temperature is sent to this communication object via the KNX/EIB. Cyclical sending can also be set in the parameters. The parameterized <i>Temperature</i>				

<p>1 Correction value is included.</p> <p>If the Floor heating N is operated without the temperature sensor, it receives the actual temperature via the KNX/EIB at this communication object.</p>				
6, 31...	Floor heating N	Actual temp. error signal	C R T	DPT 1.005 1 bit
<p>An error signal can be sent to the KNX/EIB with this object if the space temperature has not been refreshed within a set period. The output of the error signal can occur 1..255 or cyclically.</p> <p>Telegram value: "0": No error "1": Error</p>				
7, 32...	Floor heating N	Normal-mode setpoint Temp.	C R W T U	DPT 9.001 2 byte
<p>The Normal-mode setpoint temperature can be modified via this input. It is stored in non-volatile memory.</p>				
8, 33...	Floor heating N	Day-mode setpoint Temp.	C R W T U	DPT 9.001 2 byte
<p>The Day-mode setpoint temperature can be modified via this input. It is stored in non-volatile memory.</p>				
9, 34...	Floor heating N	Night-mode setpoint Temp.	C R W T U	DPT 9.001 2 byte
<p>The Night-mode setpoint temperature can be modified via this input. It is stored in non-volatile memory.</p>				
10, 35...	Floor heating N	Away-mode setpoint Temp.	C R W T U	DPT 9.001 2 byte
<p>The Away-mode setpoint temperature can be modified via this input. It is stored in non-volatile memory.</p>				
11, 36...	Floor heating N	Preset 1 Temp. for timer mode	C R W T U	DPT 9.001 2 byte
<p>The Time-mode preset 1 temperature can be modified via this input. It is stored in non-volatile memory.</p>				
12, 37...	Floor heating N	Time of day for preset 1	C R W T U	DPT 10.001 3 byte
<p>The Time-mode preset 1 start time can be modified via this input. It is stored in non-volatile memory.</p>				
13, 38...	Floor heating N	Start/Stop heating for preset 1	C R W T U	DPT 1.010 1 bit
<p>The Time-mode floor heating start or stop in this preset 1 time can be modified via this input. It is stored in non-volatile memory.</p>				
14, 39...	Floor heating N	Preset 2 Temp. for timer mode	C R W T U	DPT 9.001 2 byte
<p>The Time-mode preset 2 temperature can be modified via this input. It is stored in non-volatile memory.</p>				

15, 40...	Floor heating N	Time of day for preset 2	C R W T U	DPT 10.001 3 byte
The Time-mode preset 2 start time can be modified via this input. It is stored in non-volatile memory.				
16, 41...	Floor heating N	Start/Stop heating for preset 2	C R W T U	DPT 1.010 1 bit
The Time-mode floor heating start or stop in this preset 2 time can be modified via this input. It is stored in non-volatile memory.				
17, 42...	Floor heating N	Preset 3 Temp. for timer mode	C R W T U	DPT 9.001 2 byte
The Time-mode preset 3 temperature can be modified via this input. It is stored in non-volatile memory.				
18, 43...	Floor heating N	Time of day for preset 3	C R W T U	DPT 10.001 3 byte
The Time-mode preset 3 start time can be modified via this input. It is stored in non-volatile memory.				
19, 44...	Floor heating N	Start/Stop heating for preset3	C R W T U	DPT 1.010 1 bit
The Time-mode floor heating start or stop in this preset 3 time can be modified via this input. It is stored in non-volatile memory.				
20, 45...	Floor heating N	Floor heating(1-ON,0-OFF)	C R W T U	DPT 1.001 1 bit
Floor heating N start working when the object receive the value is "1", and stop working when the object receive the value is "0".				
21, 46...	Floor heating N	ON CMD for Normal-mode	C R W T U	DPT 1.001 1 bit
Input object for switching to Normal-mode. Telegram value: "0": No function "1": Normal mode				
22, 47...	Floor heating N	ON CMD for Day-mode	C R W T U	DPT 1.001 1 bit
Input object for switching to Day -mode. Telegram value: "0": No function "1": Day mode				
23, 48...	Floor heating N	ON CMD for Night-mode	C R W T U	DPT 1.001 1 bit
Input object for switching to Night -mode. Telegram value: "0": No function "1": Night mode				
24, 49...	Floor heating N	ON CMD for Away-mode	C R W T U	DPT 1.001 1 bit
Input object for switching to Away -mode.				

Telegram value: "0": No function "1": Away mode				
25, 50...	Floor heating N	ON CMD for Timer-mode	C R W T U	DPT 1.001 1 bit
Input object for switching to Timer -mode. Telegram value: "0": No function "1": Timer mode				
26, 51...	Floor heating N	Status valve position	C R T	DPT 1.001 1 bit
This communication object is visible if the parameter window <i>Enable 1Bit object</i> "Valve position status" is enabled in the parameter window <i>Valve</i> . The status of the valve position is visible via this communication object. Hereby, the target position where the valve should move to is always transferred. If the value '1' is set in the parameter "Object value with valve position>0": Telegram value: '0' = Valve position equal to zero "1" = Valve position not equal to zero If the value '0' is set in the parameter "Object value with valve position>0": Telegram value: '0' = Valve position not equal to zero "1" = Valve position equal to zero				
27, 52...	Floor heating N	Trigger valve purge	C W U	DPT 1.017 1 bit
The Floor heating N valve purge is triggered using this communication object. The purge cycle with automatic purge will be restarted. Telegram value: '0' = end valve purge, valve will be closed "1" = start valve purge, valve will be opened				
28, 53...	Floor heating N	Status valve purge	C R T	DPT 1.003 1 bit
The status of the Floor heating N valve purge is visible via this communication object. Telegram value: '0' = valve purge not active "1" = valve purge active				
29, 54...	Floor heating N	Instantaneous setpoint temp.	C R T	DPT 9.001 2 byte
The instantaneous setpoint (current mode setpoint temperature) can be read out from this communication object.				

4.4 Switch actuator

In this section will introduce the switch actuator communication objects, The objects will show by setting the switch actuator function enable .

Note: In following sections the **N=A,B,C,D,E**

4.4.1 Objects “Output N”


180	Output A	Channel output	1 bit	C	-	W	-	U	Low
181	Output A	Always response switch state	1 bit	C	R	-	T	-	Low
182	Output A	R/W statistic for time	2 Byte	C	R	W	T	U	Low
183	Output A	Alarm statistic for time out	1 bit	C	R	-	T	-	Low
184	Output A	Staircase light	1 bit	C	-	W	-	U	Low
185	Output A	Change staircase lighting time	2 Byte	C	-	W	-	U	Low
186	Output A	Alarm staircase lighting	1 bit	C	R	-	T	-	Low
187	Relay A	R/W statistic for counter	4 Byte	C	R	W	T	U	Low

NO.	Object name	Function	Flags	Data type
180, 190...	Output N	Channel output	C W U	DPT 1.001 1 bit
These communication objects of the channel output used for ON/OFF an channel, the switch output ON when the object receive the value is “1”. the switch output OFF when the object receive the value is “0”				
181, 191...	Output N	Always response switch state or Response state after change	C R T	DPT 1.001 1 bit
This communication object used response the channel N status, If channel status is ON,then the response status value is “1”, Otherwise the status value is “0”				
182, 192...	Output N	Read/Write statistic for time	C R W T U	DPT 7.007 2 byte
This communication object is used for statistics ON time of the channel “N”. it can be read/wrote via bus by setting this function activity				
183, 193...	Output N	Alarm statistic for time out	C R T	DPT 1.005 1 bit
This communication object is used for statistic alarm when ON time out set range.				
184, 194...	Output N	Staircase light	C W U	DPT 1.001 1 bit
This communication object is used for start or stop staircase light				
185, 195...	Output N	Change staircase lighting time	C W U	DPT 7.005 2 byte
This communication object is used to modify the staircase lighting running				

time. Allow modify staircase lighting time via bus by setting this function activity.				
186, 196...	Output A	Alarm staircase lighting	C R T	DPT 1.005 1 bit
This communication object is used to alarm the staircase lighting. If the function is activated, the staircase lighting start or stop ,the communication object will alarm via bus. channel “N” is ON alarm “1”, Otherwise alarm “0”.				
187, 197...	Relay N	R/W statistic for counter	C R W T U	DPT 12.001 4 byte
This communication object is used for statistics ON counter of the channel “N”. it can be read/write via bus by setting this function activity				


5- Application

5.1 Program functions diagram

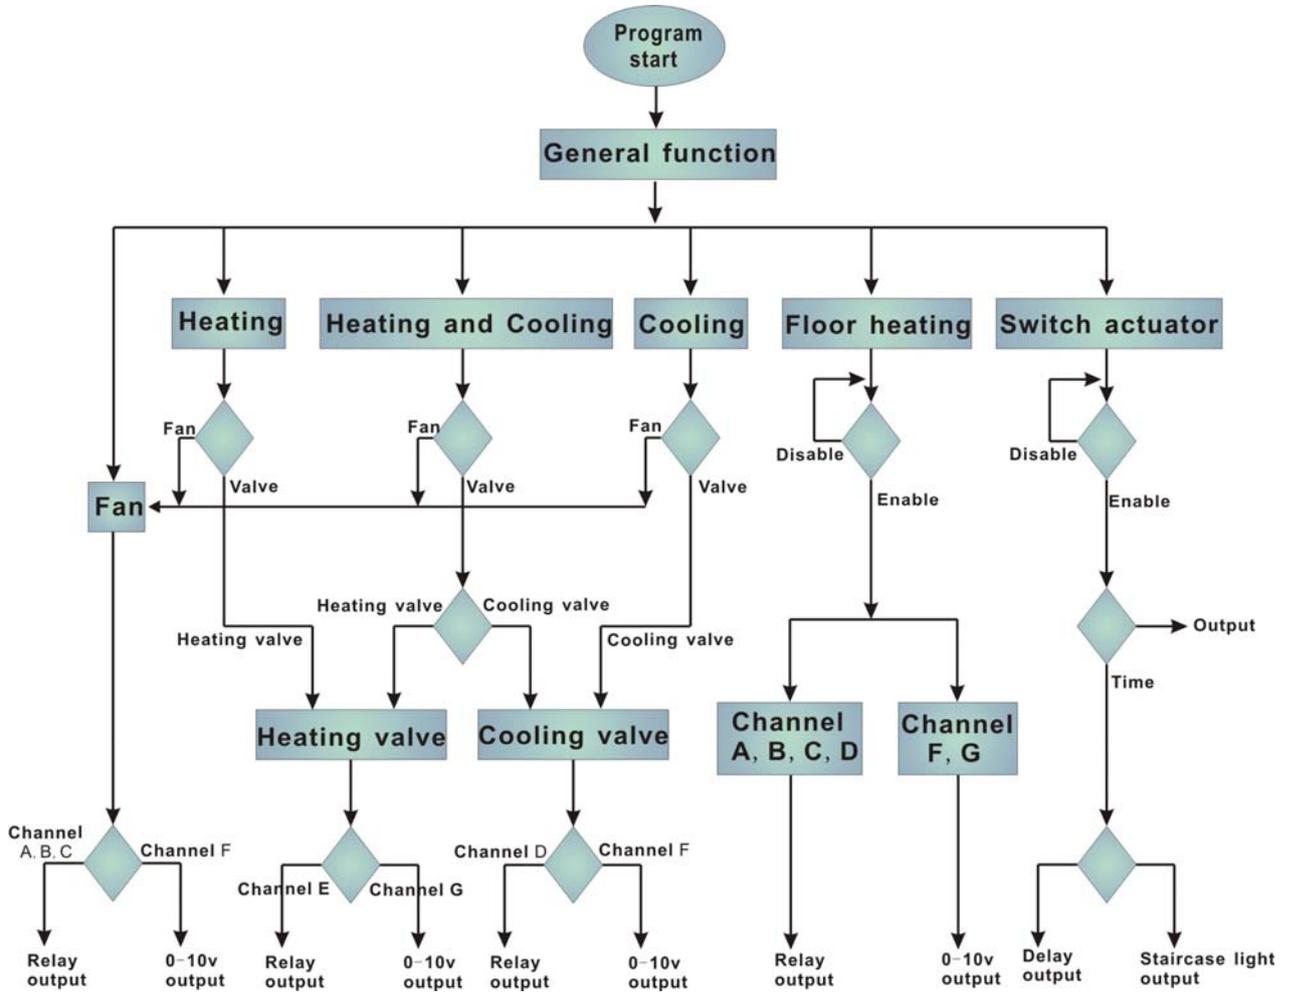

5.2 Room thermostat with the Fan Coil Controller

The setpoint temperature, HVAC mode, fan speed and the toggling of the HVAC control mode are carried out via an KNX operator panel (e.g. M/DLP04.1 - used the HVAC mode), it also can be monitoring the actual temperature to display.

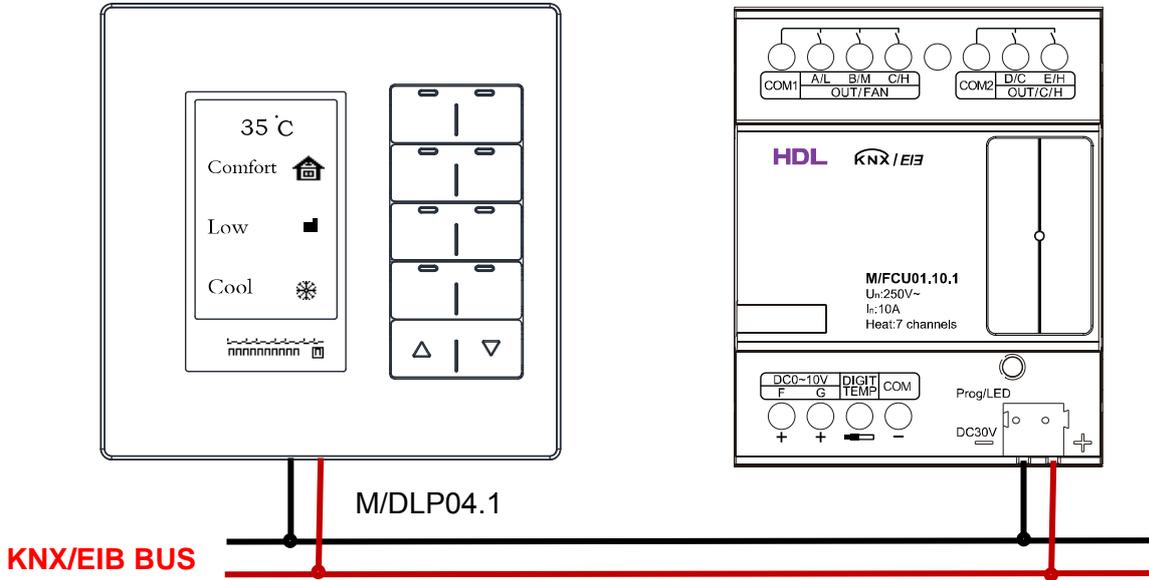

5.3 Room thermostat with the floor heating

The setpoint temperature, and the toggling of the operation are carried out via an KNX operator panel (e.g. M/DLP04.1 - used the floor heating mode), it also can be monitoring the actual temperature to display .

